

HIGH-EFFICIENCY
R-32 SPLIT-SYSTEM AIR CONDITIONER
UP TO 17.2 SEER2
2 TO 5 TONS



Contents

Nomenclature..... 2
 Product Specifications..... 3
 Expanded Cooling Data 4
 Performance Data 20
 Wiring Diagram..... 21
 Dimensions 22
 Accessories 22



Standard Features

- Two-Stage Copeland Ultra-Tech scroll compressor
- Quiet two-speed ECM outdoor fan motor
- Integrated communicating ComfortBridge™ Technology
- Commissioning and diagnostics via Bluetooth indoor board via CoolCloud™ App
- Copeland® ComfortAlert™ built in diagnostics
- Copper tube/ enhanced aluminum fin coil-5mm on 2.0-3.0T
- Color-coded terminal strip for non-communicating set-up
- Only two low-voltage wires required in communication mode
- Factory-installed filter drier
- Factory-installed transformer
- Factory-installed high and low-pressure switches
- High-density foam compressor sound blanket
- Fully charged for 15' of tubing length
- Ambient temperature sensors
- Ground lug connection
- AHRI Certified - ETL Listed

Cabinet Features

- Removable grille-style top design compliant with UL 60335-2-40
- Venturi for increased velocity of airflow
- Heavy-gauge galvanized steel cabinet
- Baked-on powder-paint finish with 500-hour salt-spray approval
- Steel louver coil guard with Rust-resistant screws.
- Top and side maintenance access
- Single-panel access to controls with space for field-installed accessories
- Service valves with sweat connections and easy-access gauge ports
- When properly anchored, meets the 2023 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



* Complete warranty details available from your local dealer or at www.amana-hac.com. To receive the Lifetime Unit Replacement Limited Warranty (good for as long as you own your home) and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration and some of the additional requirements are not required in Florida, California, or Québec. The duration of warranty coverage in Texas and Florida differs in some cases. Other limitations and exclusions apply; refer to complete warranty details for a full list of limitations and exclusions.

| | A | L | X | T | 7 | C | A | 36 | 1 | 0 | A | A | | |
|-----------------------------------|---|---|---|---|---|---|---|-----|----|----|----|-------------------------|--|--|
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8,9 | 10 | 11 | 12 | * | * | |
| Brand | A Amana Brand | | | | | | | | | | | Minor Rev | A | |
| Type | L R-32 Split System | | | | | | | | | | | Major Revisions | A | |
| Outdoor Type | X Condenser Z Heat Pump | | | | | | | | | | | Variation | | |
| Compressor Type | S Single Stage T Two Stage V Variable Speed | | | | | | | | | | | Electrical | 208/230 V, 1 Phase, 60 Hz | |
| Efficiency (SEER2) Nominal | 13.4 - 13.7 = 3 16.0 - 16.9 = 6 13.8 - 14.5 = 4 17.0 - 17.9 = 7 14.6 - 15.5 = 5 18.0 - 18.9 = 8 19.0+ = 9 | | | | | | | | | | | Nominal Capacity | 18 - 1.5 Ton 42 - 3.5 Tons 24 - 2.0 Tons 48 - 4.0 Tons 30 - 2.5 Tons 60 - 5.0 Tons 36 - 3.0 Tons | |
| | | | | | | | | | | | | | Sales Region | N - North S - Southeast & North A - All Region |
| | | | | | | | | | | | | | Feature/Application | B - Standard M - Multi-Family C - Communicating (Top Flow) S - Side Discharge Communicating |

| | ALXT7CA 2410A* | ALXT7CA 3610A* | ALXT7CA 4810A* | ALXT7CA 6010A* |
|--|-------------------|-------------------|-------------------|-------------------|
| COOLING CAPACITY | | | | |
| Nominal Cooling (BTU/h) | 24,000 | 36,000 | 48,000 | 60,000 |
| Decibels (High/Low) | 69.0 | 70.0 | 73.0 | 75.0 |
| COMPRESSOR | | | | |
| RLA | 9.9 | 14.5 | 23.2 | 27.1 |
| LRA | 68 | 91 | 128 | 178 |
| Stage | Two | Two | Two | Two |
| Type | Scroll | Scroll | Scroll | Scroll |
| CONDENSER FAN MOTOR | | | | |
| Motor Type | ECM | ECM | ECM | ECM |
| Horsepower (RPM) | ⅓ | ⅓ | ⅓ | ⅓ |
| FLA | 2.60 | 2.60 | 2.60 | 2.60 |
| REFRIGERATION SYSTEM | | | | |
| Refrigerant Line Size ¹ | | | | |
| Liquid Line Size ("O.D.) | ⅜" | ⅜" | ⅜" | ⅜" |
| Suction Line Size ("O.D.) | ¾" | ⅞" | 1⅛" | 1⅛" |
| Refrigerant Connection Size | | | | |
| Liquid Valve Size ("O.D.) | ⅜" | ⅜" | ⅜" | ⅜" |
| Suction Valve Size ("O.D.) ² | ¾" | ¾" | ⅞" | ⅞" |
| Valve Connection Type | Sweat | Sweat | Sweat | Sweat |
| Refrigerant Charge ³ | 104 | 92 | 180 | 167 |
| ELECTRICAL DATA | | | | |
| Voltage-Phase-Hz | 208/230-1 | 208/230-1 | 208/230-1 | 208/230-1 |
| Minimum Circuit Ampacity ⁴ | 15.3 | 24.1 | 28.3 | 32.4 |
| Max. Overcurrent Protection ⁵ | 25 | 40 | 45 | 50 |
| Min / Max Volts | 197 / 253 | 197 / 253 | 197 / 253 | 197 / 253 |
| Electrical Conduit Size | ½" or ¾" | ½" or ¾" | ½" or ¾" | ½" or ¾" |
| EQUIPMENT WEIGHT (LBS) | | | | |
| | 214 | 216 | 276 | 283 |
| SHIP WEIGHT (LBS) | | | | |
| | 219 | 221 | 281 | 288 |

¹ Line sizes denoted for 25' line sets, tested and rated in accordance with ARI Standard 210/240. For other line set lengths or sizes, refer to the Installation Instructions and/or the Long Line Set Applications guide.

² Any suction line adapter will need to be supplied by the field.

³ Unit is factory charged with refrigerant for 15' of ⅜" liquid line. System charge must be adjusted per the Final Charge Adjustment procedure found in the Installation Instructions.

⁴ Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

⁵ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.

EXPANDED COOLING DATA — ALXT7CA2410**/CA*TA2422*3A*+EEP - HIGH STAGE

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|------|-----------------------------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|-------|----|----|----|--|--|-------|--|--|--|--|--|
| | | 65°F | | | | | | 75°F | | | | | | 85°F | | | | | | 95°F | | | | | | 105°F | | | | | | 115°F | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | | | | | |
| 70 | MBh | 24.3 | 24.7 | 25.4 | - | 24.1 | 24.4 | 25.2 | - | 23.5 | 23.8 | 24.5 | - | 22.4 | 22.7 | 23.4 | - | 21.0 | 21.4 | 22.1 | - | 19.8 | 20.1 | 20.9 | - | | | | | | | | | | | | |
| | S/T | 0.56 | 0.49 | 0.36 | - | 0.57 | 0.50 | 0.36 | - | 0.59 | 0.52 | 0.39 | - | 1.00 | 0.54 | 0.41 | - | 1.00 | 0.56 | 0.43 | - | 1.00 | 0.61 | 0.48 | - | | | | | | | | | | | | |
| | ΔT | 20 | 19 | 15 | - | 20 | 19 | 15 | - | 21 | 19 | 15 | - | 20 | 19 | 15 | - | 20 | 18 | 15 | - | 21 | 19 | 16 | - | | | | | | | | | | | | |
| | kW | 1.44 | 1.44 | 1.44 | - | 1.60 | 1.60 | 1.60 | - | 1.78 | 1.78 | 1.78 | - | 1.97 | 1.97 | 1.97 | - | 2.19 | 2.19 | 2.19 | - | 2.44 | 2.44 | 2.44 | - | | | | | | | | | | | | |
| | Amps | 4.7 | 4.7 | 4.6 | - | 5.4 | 5.4 | 5.3 | - | 6.1 | 6.1 | 6.1 | - | 7.0 | 7.0 | 7.0 | - | 7.9 | 7.9 | 7.9 | - | 9.0 | 9.0 | 9.0 | - | | | | | | | | | | | | |
| 840 | MBh | 24.7 | 25.1 | 25.8 | - | 24.5 | 24.9 | 25.6 | - | 23.9 | 24.2 | 25.0 | - | 22.8 | 23.1 | 23.9 | - | 21.4 | 21.8 | 22.5 | - | 20.2 | 20.6 | 21.3 | - | | | | | | | | | | | | |
| | S/T | 0.65 | 0.57 | 0.44 | - | 0.66 | 0.58 | 0.45 | - | 0.68 | 0.61 | 0.47 | - | 1.00 | 0.62 | 0.49 | - | 1.00 | 0.65 | 0.51 | - | 1.00 | 0.70 | 0.56 | - | | | | | | | | | | | | |
| | ΔT | 19 | 17 | 14 | - | 19 | 17 | 14 | - | 19 | 17 | 14 | - | 19 | 17 | 14 | - | 19 | 17 | 13 | - | 20 | 18 | 14 | - | | | | | | | | | | | | |
| | kW | 1.45 | 1.45 | 1.45 | - | 1.61 | 1.61 | 1.61 | - | 1.79 | 1.79 | 1.79 | - | 1.99 | 1.98 | 1.98 | - | 2.20 | 2.20 | 2.20 | - | 2.45 | 2.45 | 2.45 | - | | | | | | | | | | | | |
| | Amps | 4.7 | 4.7 | 4.7 | - | 5.4 | 5.4 | 5.4 | - | 6.2 | 6.2 | 6.2 | - | 7.0 | 7.0 | 7.0 | - | 8.0 | 8.0 | 7.9 | - | 9.1 | 9.1 | 9.0 | - | | | | | | | | | | | | |
| 900 | MBh | 24.9 | 25.3 | 26.0 | - | 24.7 | 25.1 | 25.8 | - | 24.1 | 24.4 | 25.2 | - | 23.0 | 23.3 | 24.1 | - | 21.7 | 22.0 | 22.7 | - | 20.4 | 20.8 | 21.5 | - | | | | | | | | | | | | |
| | S/T | 0.67 | 0.60 | 0.46 | - | 0.68 | 0.60 | 0.47 | - | 0.70 | 0.63 | 0.49 | - | 1.00 | 0.65 | 0.51 | - | 1.00 | 0.67 | 0.54 | - | 1.00 | 0.72 | 0.59 | - | | | | | | | | | | | | |
| | ΔT | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 19 | 17 | 13 | - | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 19 | 17 | 14 | - | | | | | | | | | | | | |
| | kW | 1.46 | 1.46 | 1.46 | - | 1.62 | 1.62 | 1.61 | - | 1.80 | 1.80 | 1.79 | - | 1.99 | 1.99 | 1.99 | - | 2.21 | 2.20 | 2.20 | - | 2.46 | 2.46 | 2.45 | - | | | | | | | | | | | | |
| | Amps | 4.7 | 4.7 | 4.7 | - | 5.4 | 5.4 | 5.4 | - | 6.2 | 6.2 | 6.2 | - | 7.0 | 7.0 | 7.0 | - | 8.0 | 8.0 | 8.0 | - | 9.1 | 9.1 | 9.1 | - | | | | | | | | | | | | |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 700 | MBh | 24.3 | 24.7 | 25.4 | 26.5 | 24.1 | 24.5 | 25.2 | 26.3 | 23.5 | 23.8 | 24.6 | 25.7 | 22.4 | 22.7 | 23.5 | 24.6 | 21.0 | 21.4 | 22.1 | 23.2 | 19.8 | 20.2 | 20.9 | 22.0 |
| | S/T | 0.69 | 0.62 | 0.48 | 0.3 | 0.70 | 0.62 | 0.49 | 0.4 | 1.00 | 0.65 | 0.51 | 0.4 | 1.00 | 0.67 | 0.53 | 0.4 | 1.00 | 0.69 | 0.55 | 0.4 | 1.00 | 1.00 | 0.61 | 0.5 |
| | ΔT | 25 | 23 | 19 | 16 | 24 | 23 | 19 | 16 | 25 | 23 | 19 | 16 | 24 | 23 | 19 | 16 | 24 | 22 | 19 | 15 | 25 | 24 | 20 | 16 |
| | kW | 1.44 | 1.44 | 1.44 | 1.5 | 1.60 | 1.60 | 1.60 | 1.6 | 1.78 | 1.78 | 1.78 | 1.8 | 1.97 | 1.97 | 1.97 | 2.0 | 2.19 | 2.19 | 2.18 | 2.2 | 2.44 | 2.44 | 2.44 | 2.4 |
| | Amps | 4.7 | 4.7 | 4.6 | 4.7 | 5.4 | 5.4 | 5.3 | 5.4 | 6.1 | 6.1 | 6.1 | 6.2 | 7.0 | 7.0 | 7.0 | 7.0 | 7.9 | 7.9 | 7.9 | 7.9 | 9.0 | 9.0 | 9.0 | 9.0 |
| 840 | MBh | 24.8 | 25.1 | 25.8 | 26.9 | 24.5 | 24.9 | 25.6 | 26.7 | 23.9 | 24.2 | 25.0 | 26.1 | 22.8 | 23.1 | 23.9 | 25.0 | 21.5 | 21.8 | 22.5 | 23.6 | 20.2 | 20.6 | 21.3 | 22.4 |
| | S/T | 0.77 | 0.70 | 0.57 | 0.4 | 1.00 | 0.71 | 0.57 | 0.4 | 1.00 | 0.73 | 0.60 | 0.5 | 1.00 | 0.75 | 0.62 | 0.5 | 1.00 | 0.77 | 0.64 | 0.5 | 1.00 | 1.00 | 0.69 | 0.6 |
| | ΔT | 23 | 21 | 18 | 14 | 23 | 21 | 18 | 14 | 23 | 21 | 18 | 14 | 23 | 21 | 18 | 14 | 23 | 21 | 17 | 14 | 24 | 22 | 19 | 15 |
| | kW | 1.45 | 1.45 | 1.45 | 1.46 | 1.61 | 1.61 | 1.61 | 1.62 | 1.79 | 1.79 | 1.79 | 1.80 | 1.98 | 1.98 | 1.98 | 1.99 | 2.20 | 2.20 | 2.20 | 2.21 | 2.45 | 2.45 | 2.45 | 2.46 |
| | Amps | 4.7 | 4.7 | 4.7 | 4.7 | 5.4 | 5.4 | 5.4 | 5.4 | 6.2 | 6.2 | 6.2 | 6.2 | 7.0 | 7.0 | 7.0 | 7.1 | 8.0 | 8.0 | 7.9 | 8.0 | 9.1 | 9.1 | 9.0 | 9.1 |
| 900 | MBh | 25.0 | 25.3 | 26.0 | 27.2 | 24.7 | 25.1 | 25.8 | 26.9 | 24.1 | 24.5 | 25.2 | 26.3 | 23.0 | 23.4 | 24.1 | 25.2 | 21.7 | 22.0 | 22.7 | 23.9 | 20.4 | 20.8 | 21.5 | 22.6 |
| | S/T | 0.80 | 0.72 | 0.59 | 0.5 | 1.00 | 0.73 | 0.60 | 0.5 | 1.00 | 0.75 | 0.62 | 0.5 | 1.00 | 0.77 | 0.64 | 0.5 | 1.00 | 1.00 | 0.66 | 0.5 | 1.00 | 1.00 | 0.71 | 0.6 |
| | ΔT | 22 | 21 | 17 | 14 | 22 | 21 | 17 | 13 | 23 | 21 | 17 | 14 | 22 | 21 | 17 | 13 | 22 | 20 | 17 | 13 | 23 | 21 | 18 | 14 |
| | kW | 1.46 | 1.46 | 1.45 | 1.5 | 1.62 | 1.62 | 1.61 | 1.6 | 1.80 | 1.79 | 1.79 | 1.8 | 1.99 | 1.99 | 1.98 | 2.0 | 2.20 | 2.20 | 2.20 | 2.2 | 2.46 | 2.46 | 2.45 | 2.5 |
| | Amps | 4.7 | 4.7 | 4.7 | 4.8 | 5.4 | 5.4 | 5.4 | 5.5 | 6.2 | 6.2 | 6.2 | 6.2 | 7.0 | 7.0 | 7.0 | 7.1 | 8.0 | 8.0 | 8.0 | 8.0 | 9.1 | 9.1 | 9.1 | 9.1 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA2410**/CA*TA2422*3A*+EEP - HIGH STAGE (CONT.)

| IDB | AIRFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|-----|---------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------|------|------|------|-------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 80 | MBh | 24.5 | 24.8 | 25.5 | 26.7 | 24.2 | 24.6 | 25.3 | 26.4 | 23.6 | 24.0 | 24.7 | 25.8 | 22.5 | 22.9 | 23.6 | 24.7 | 21.2 | 21.5 | 22.2 | 23.4 | 20.1 | 20.4 | 21.1 | 22.1 |
| | S/T | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.77 | 0.64 | 0.5 | 1.00 | 1.00 | 0.66 | 0.5 | 1.00 | 1.00 | 0.68 | 0.5 | 1.00 | 1.00 | 0.73 | 0.6 |
| | ΔT | 29 | 27 | 23 | 20 | 29 | 27 | 23 | 20 | 29 | 27 | 24 | 20 | 29 | 27 | 23 | 20 | 28 | 26 | 23 | 19 | 29 | 28 | 24 | 21 |
| | kW | 1.44 | 1.44 | 1.44 | 1.5 | 1.60 | 1.60 | 1.60 | 1.6 | 1.78 | 1.78 | 1.78 | 1.8 | 1.97 | 1.97 | 1.97 | 2.0 | 2.19 | 2.19 | 2.19 | 2.2 | 2.44 | 2.44 | 2.44 | 2.5 |
| | Amps | 4.7 | 4.7 | 4.6 | 4.7 | 5.4 | 5.4 | 5.3 | 5.4 | 6.1 | 6.1 | 6.1 | 6.2 | 7.0 | 7.0 | 7.0 | 7.0 | 7.9 | 7.9 | 7.9 | 7.9 | 9.0 | 9.0 | 9.0 | 9.0 |
| 80 | MBh | 24.9 | 25.2 | 26.0 | 27.1 | 24.7 | 25.0 | 25.7 | 26.8 | 24.0 | 24.4 | 25.1 | 26.2 | 22.9 | 23.3 | 24.0 | 25.1 | 21.6 | 21.9 | 22.7 | 23.8 | 20.4 | 20.7 | 21.4 | 22.5 |
| | S/T | 1.00 | 0.82 | 0.69 | 0.6 | 1.00 | 0.83 | 0.70 | 0.6 | 1.00 | 0.85 | 0.72 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.81 | 0.7 |
| | ΔT | 27 | 25 | 22 | 18 | 27 | 25 | 22 | 18 | 27 | 25 | 22 | 18 | 27 | 25 | 22 | 18 | 27 | 25 | 21 | 18 | 28 | 26 | 23 | 19 |
| | kW | 1.45 | 1.45 | 1.45 | 1.46 | 1.61 | 1.61 | 1.61 | 1.62 | 1.79 | 1.79 | 1.79 | 1.80 | 1.99 | 1.98 | 1.98 | 1.99 | 2.20 | 2.20 | 2.20 | 2.21 | 2.45 | 2.45 | 2.45 | 2.46 |
| | Amps | 4.7 | 4.7 | 4.7 | 4.8 | 5.4 | 5.4 | 5.4 | 5.4 | 6.2 | 6.2 | 6.2 | 6.2 | 7.0 | 7.0 | 7.0 | 7.1 | 8.0 | 8.0 | 7.9 | 8.0 | 9.1 | 9.1 | 9.1 | 9.1 |
| 900 | MBh | 25.1 | 25.4 | 26.2 | 27.3 | 24.9 | 25.2 | 25.9 | 27.1 | 24.2 | 24.6 | 25.3 | 26.4 | 23.1 | 23.5 | 24.2 | 25.3 | 21.8 | 22.1 | 22.9 | 24.0 | 20.6 | 20.9 | 21.6 | 22.8 |
| | S/T | 1.00 | 0.84 | 0.71 | 0.6 | 1.00 | 0.85 | 0.72 | 0.6 | 1.00 | 0.88 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 | 1.00 | 1.00 | 0.83 | 0.7 |
| | ΔT | 27 | 25 | 21 | 18 | 26 | 25 | 21 | 18 | 27 | 25 | 21 | 18 | 26 | 25 | 21 | 18 | 26 | 24 | 21 | 17 | 27 | 26 | 22 | 18 |
| | kW | 1.46 | 1.46 | 1.45 | 1.5 | 1.62 | 1.62 | 1.61 | 1.6 | 1.80 | 1.80 | 1.79 | 1.8 | 1.99 | 1.99 | 1.99 | 2.0 | 2.21 | 2.20 | 2.20 | 2.2 | 2.46 | 2.46 | 2.45 | 2.5 |
| | Amps | 4.7 | 4.7 | 4.7 | 4.8 | 5.4 | 5.4 | 5.4 | 5.5 | 6.2 | 6.2 | 6.2 | 6.2 | 7.0 | 7.0 | 7.0 | 7.1 | 8.0 | 8.0 | 8.0 | 8.0 | 9.1 | 9.1 | 9.1 | 9.1 |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 85 | MBh | 24.9 | 25.2 | 25.9 | 27.1 | 24.7 | 25.0 | 25.7 | 26.8 | 24.0 | 24.4 | 25.1 | 26.2 | 22.9 | 23.3 | 24.0 | 25.1 | 21.6 | 21.9 | 22.7 | 23.8 | 20.4 | 20.7 | 21.4 | 22.5 |
| | S/T | 1.00 | 0.84 | 0.70 | 0.6 | 1.00 | 1.00 | 0.71 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 | 1.00 | 1.00 | 1.00 | 0.7 |
| | ΔT | 32 | 30 | 27 | 23 | 32 | 30 | 27 | 23 | 32 | 31 | 27 | 24 | 32 | 30 | 27 | 23 | 32 | 30 | 27 | 23 | 33 | 31 | 28 | 24 |
| | kW | 1.45 | 1.45 | 1.44 | 1.5 | 1.61 | 1.60 | 1.60 | 1.6 | 1.78 | 1.78 | 1.78 | 1.8 | 1.98 | 1.98 | 1.97 | 2.0 | 2.19 | 2.19 | 2.19 | 2.2 | 2.45 | 2.44 | 2.44 | 2.5 |
| | Amps | 4.7 | 4.7 | 4.7 | 4.7 | 5.4 | 5.4 | 5.4 | 5.4 | 6.1 | 6.1 | 6.1 | 6.2 | 7.0 | 7.0 | 7.0 | 7.0 | 7.9 | 7.9 | 7.9 | 8.0 | 9.0 | 9.0 | 9.0 | 9.1 |
| 840 | MBh | 25.3 | 25.6 | 26.4 | 27.5 | 25.1 | 25.4 | 26.1 | 27.3 | 24.4 | 24.8 | 25.5 | 26.6 | 23.3 | 23.7 | 24.4 | 25.5 | 22.0 | 22.3 | 23.1 | 24.2 | 20.8 | 21.1 | 21.8 | 23.0 |
| | S/T | 1.00 | 0.92 | 0.79 | 0.7 | 1.00 | 1.00 | 0.80 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 31 | 29 | 25 | 22 | 31 | 29 | 25 | 22 | 31 | 29 | 26 | 22 | 31 | 29 | 25 | 22 | 30 | 29 | 25 | 22 | 32 | 30 | 26 | 23 |
| | kW | 1.46 | 1.46 | 1.45 | 1.47 | 1.62 | 1.62 | 1.61 | 1.63 | 1.80 | 1.79 | 1.79 | 1.80 | 1.99 | 1.99 | 1.98 | 2.00 | 2.20 | 2.20 | 2.20 | 2.21 | 2.46 | 2.46 | 2.45 | 2.47 |
| | Amps | 4.7 | 4.7 | 4.7 | 4.8 | 5.4 | 5.4 | 5.4 | 5.5 | 6.2 | 6.2 | 6.2 | 6.2 | 7.0 | 7.0 | 7.0 | 7.1 | 8.0 | 8.0 | 8.0 | 8.0 | 9.1 | 9.1 | 9.1 | 9.1 |
| 900 | MBh | 25.5 | 25.8 | 26.6 | 27.7 | 25.3 | 25.6 | 26.4 | 27.5 | 24.6 | 25.0 | 25.7 | 26.8 | 23.5 | 23.9 | 24.6 | 25.7 | 22.2 | 22.6 | 23.3 | 24.4 | 21.0 | 21.3 | 22.1 | 23.2 |
| | S/T | 1.00 | 0.94 | 0.81 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 0.86 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 30 | 28 | 25 | 21 | 30 | 28 | 25 | 21 | 30 | 29 | 25 | 21 | 30 | 28 | 25 | 21 | 30 | 28 | 25 | 21 | 31 | 29 | 26 | 22 |
| | kW | 1.46 | 1.46 | 1.46 | 1.5 | 1.62 | 1.62 | 1.62 | 1.6 | 1.80 | 1.80 | 1.80 | 1.8 | 1.99 | 1.99 | 1.99 | 2.0 | 2.21 | 2.21 | 2.20 | 2.2 | 2.46 | 2.46 | 2.46 | 2.5 |
| | Amps | 4.7 | 4.7 | 4.7 | 4.8 | 5.4 | 5.4 | 5.4 | 5.5 | 6.2 | 6.2 | 6.2 | 6.3 | 7.1 | 7.1 | 7.0 | 7.1 | 8.0 | 8.0 | 8.0 | 8.0 | 9.1 | 9.1 | 9.1 | 9.1 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA2410**/CA*TA2422*3A*+EEP - LOW STAGE

| IDB AIRFLOW | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|---------------|------|-----------------------------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|-------|------|------|----|-------|------|------|----|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 490 | MBh | 17.5 | 17.7 | 18.3 | - | 17.3 | 17.6 | 18.1 | - | 16.9 | 17.1 | 17.6 | - | 16.1 | 16.3 | 16.9 | - | 15.1 | 15.4 | 15.9 | - | 14.2 | 14.5 | 15.0 | - |
| | S/T | 0.58 | 0.50 | 0.37 | - | 0.59 | 0.51 | 0.37 | - | 0.61 | 0.53 | 0.40 | - | 1.00 | 0.55 | 0.42 | - | 1.00 | 0.58 | 0.44 | - | 1.00 | 0.63 | 0.49 | - |
| | ΔT | 20 | 18 | 15 | - | 20 | 18 | 15 | - | 20 | 18 | 15 | - | 20 | 18 | 15 | - | 19 | 18 | 14 | - | 21 | 19 | 15 | - |
| | kW | 0.91 | 0.91 | 0.91 | - | 1.01 | 1.01 | 1.01 | - | 1.12 | 1.12 | 1.12 | - | 1.24 | 1.24 | 1.24 | - | 1.38 | 1.38 | 1.37 | - | 1.54 | 1.54 | 1.53 | - |
| | Amps | 2.9 | 2.9 | 2.9 | - | 3.4 | 3.4 | 3.4 | - | 3.9 | 3.9 | 3.8 | - | 4.4 | 4.4 | 4.4 | - | 5.0 | 5.0 | 5.0 | - | 5.7 | 5.7 | 5.7 | - |
| 70 | MBh | 17.8 | 18.0 | 18.6 | - | 17.6 | 17.9 | 18.4 | - | 17.2 | 17.4 | 17.9 | - | 16.4 | 16.6 | 17.2 | - | 15.4 | 15.7 | 16.2 | - | 14.5 | 14.8 | 15.3 | - |
| | S/T | 0.67 | 0.59 | 0.45 | - | 0.67 | 0.60 | 0.46 | - | 1.00 | 0.62 | 0.49 | - | 1.00 | 0.64 | 0.51 | - | 1.00 | 0.66 | 0.53 | - | 1.00 | 1.00 | 0.58 | - |
| | ΔT | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 18 | 17 | 13 | - | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 19 | 17 | 14 | - |
| | kW | 0.92 | 0.91 | 0.91 | - | 1.02 | 1.01 | 1.01 | - | 1.13 | 1.13 | 1.13 | - | 1.25 | 1.25 | 1.25 | - | 1.38 | 1.38 | 1.38 | - | 1.54 | 1.54 | 1.54 | - |
| | Amps | 3.0 | 3.0 | 3.0 | - | 3.4 | 3.4 | 3.4 | - | 3.9 | 3.9 | 3.9 | - | 4.4 | 4.4 | 4.4 | - | 5.0 | 5.0 | 5.0 | - | 5.7 | 5.7 | 5.7 | - |
| 630 | MBh | 17.9 | 18.2 | 18.7 | - | 17.8 | 18.0 | 18.6 | - | 17.3 | 17.6 | 18.1 | - | 16.5 | 16.8 | 17.3 | - | 15.6 | 15.8 | 16.3 | - | 14.7 | 14.9 | 15.5 | - |
| | S/T | 0.69 | 0.61 | 0.48 | - | 0.70 | 0.62 | 0.48 | - | 1.00 | 0.64 | 0.51 | - | 1.00 | 0.66 | 0.53 | - | 1.00 | 0.69 | 0.55 | - | 1.00 | 1.00 | 0.60 | - |
| | ΔT | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 17 | 16 | 12 | - | 19 | 17 | 13 | - |
| | kW | 0.92 | 0.92 | 0.92 | - | 1.02 | 1.02 | 1.02 | - | 1.13 | 1.13 | 1.13 | - | 1.25 | 1.25 | 1.25 | - | 1.39 | 1.39 | 1.38 | - | 1.55 | 1.55 | 1.54 | - |
| | Amps | 3.0 | 3.0 | 3.0 | - | 3.4 | 3.4 | 3.4 | - | 3.9 | 3.9 | 3.9 | - | 4.4 | 4.4 | 4.4 | - | 5.0 | 5.0 | 5.0 | - | 5.7 | 5.7 | 5.7 | - |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 490 | MBh | 17.5 | 17.7 | 18.3 | 19.1 | 17.3 | 17.6 | 18.1 | 18.9 | 16.9 | 17.1 | 17.7 | 17.7 | 16.1 | 16.3 | 16.9 | 17.7 | 15.1 | 15.4 | 15.9 | 16.7 | 14.2 | 14.5 | 15.0 | 15.8 |
| | S/T | 0.71 | 0.63 | 0.50 | 0.4 | 1.00 | 0.64 | 0.50 | 0.4 | 1.00 | 0.66 | 0.53 | 0.4 | 1.00 | 0.68 | 0.55 | 0.4 | 1.00 | 1.00 | 0.57 | 0.4 | 1.00 | 1.00 | 0.62 | 0.5 |
| | ΔT | 24 | 22 | 19 | 15 | 24 | 22 | 18 | 15 | 24 | 22 | 19 | 15 | 24 | 22 | 18 | 15 | 23 | 22 | 18 | 15 | 24 | 23 | 19 | 16 |
| | kW | 0.91 | 0.91 | 0.90 | 0.9 | 1.01 | 1.01 | 1.01 | 1.0 | 1.12 | 1.12 | 1.12 | 1.1 | 1.24 | 1.24 | 1.24 | 1.2 | 1.38 | 1.38 | 1.37 | 1.4 | 1.54 | 1.54 | 1.53 | 1.5 |
| | Amps | 2.9 | 2.9 | 2.9 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.8 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |
| 588 | MBh | 17.8 | 18.0 | 18.6 | 19.4 | 17.6 | 17.9 | 18.4 | 19.2 | 17.2 | 17.4 | 18.0 | 18.8 | 16.4 | 16.6 | 17.2 | 18.0 | 15.4 | 15.7 | 16.2 | 17.0 | 14.5 | 14.8 | 15.3 | 16.1 |
| | S/T | 0.80 | 0.72 | 0.58 | 0.4 | 1.00 | 0.73 | 0.59 | 0.4 | 1.00 | 0.75 | 0.62 | 0.5 | 1.00 | 0.77 | 0.63 | 0.5 | 1.00 | 1.00 | 0.66 | 0.5 | 1.00 | 1.00 | 0.71 | 0.6 |
| | ΔT | 22 | 20 | 17 | 14 | 22 | 20 | 17 | 14 | 22 | 21 | 17 | 14 | 22 | 20 | 17 | 14 | 22 | 20 | 17 | 13 | 23 | 21 | 18 | 14 |
| | kW | 0.91 | 0.91 | 0.91 | 0.92 | 1.01 | 1.01 | 1.01 | 1.02 | 1.13 | 1.13 | 1.12 | 1.13 | 1.25 | 1.25 | 1.25 | 1.25 | 1.38 | 1.38 | 1.38 | 1.39 | 1.54 | 1.54 | 1.54 | 1.55 |
| | Amps | 3.0 | 3.0 | 3.0 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |
| 630 | MBh | 17.9 | 18.2 | 18.7 | 19.5 | 17.8 | 18.0 | 18.6 | 19.4 | 17.3 | 17.6 | 18.1 | 18.9 | 16.5 | 16.8 | 17.3 | 18.1 | 15.6 | 15.8 | 16.4 | 17.2 | 14.7 | 14.9 | 15.5 | 16.3 |
| | S/T | 0.82 | 0.74 | 0.61 | 0.5 | 1.00 | 0.75 | 0.61 | 0.5 | 1.00 | 0.77 | 0.64 | 0.5 | 1.00 | 0.79 | 0.66 | 0.5 | 1.00 | 1.00 | 0.68 | 0.5 | 1.00 | 1.00 | 0.73 | 0.6 |
| | ΔT | 22 | 20 | 17 | 13 | 22 | 20 | 16 | 13 | 22 | 20 | 17 | 13 | 22 | 20 | 16 | 13 | 21 | 20 | 16 | 13 | 22 | 21 | 17 | 14 |
| | kW | 0.92 | 0.92 | 0.91 | 0.9 | 1.02 | 1.02 | 1.02 | 1.0 | 1.13 | 1.13 | 1.13 | 1.1 | 1.25 | 1.25 | 1.25 | 1.3 | 1.39 | 1.39 | 1.38 | 1.4 | 1.55 | 1.54 | 1.54 | 1.6 |
| | Amps | 3.0 | 3.0 | 3.0 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA2410**/CA*TA2422*3A*+EEP - LOW STAGE (CONT.)

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|------------|---------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------------|-------------|------|-------|------|------|------|-------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 80 | AIRFLOW | 17.6 | 17.8 | 18.4 | 19.2 | 17.4 | 17.7 | 18.2 | 19.0 | 17.0 | 17.2 | 17.7 | 18.5 | 16.2 | 16.4 | 17.0 | 17.8 | 15.2 | 15.5 | 16.0 | 16.8 | 14.3 | 14.6 | 15.1 | 15.9 |
| | MBh | 1.00 | 0.76 | 0.62 | 0.5 | 1.00 | 0.76 | 0.63 | 0.5 | 1.00 | 0.79 | 0.65 | 0.5 | 1.00 | 1.00 | 0.67 | 0.5 | 1.00 | 1.00 | 0.70 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 |
| | S/T | 28 | 26 | 22 | 19 | 28 | 26 | 22 | 19 | 28 | 26 | 23 | 19 | 28 | 26 | 22 | 19 | 27 | 26 | 22 | 19 | 28 | 27 | 23 | 20 |
| | ΔT | 0.91 | 0.91 | 0.91 | 0.9 | 1.01 | 1.01 | 1.01 | 1.0 | 1.12 | 1.12 | 1.12 | 1.1 | 1.24 | 1.24 | 1.24 | 1.2 | 1.38 | 1.38 | 1.37 | 1.4 | 1.54 | 1.54 | 1.53 | 1.5 |
| | kW | 2.9 | 2.9 | 2.9 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |
| Amps | 17.9 | 18.1 | 18.7 | 19.5 | 17.7 | 18.0 | 18.5 | 19.3 | 17.3 | 17.5 | 18.0 | 18.8 | 16.5 | 16.7 | 17.3 | 18.1 | 15.5 | 15.8 | 16.3 | 17.1 | 14.6 | 14.9 | 15.4 | 16.2 | |
| 588 | MBh | 1.00 | 0.85 | 0.71 | 0.6 | 1.00 | 0.85 | 0.72 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 | 1.00 | 1.00 | 1.00 | 0.7 |
| | S/T | 26 | 24 | 21 | 18 | 26 | 24 | 21 | 17 | 26 | 25 | 21 | 18 | 26 | 24 | 21 | 17 | 26 | 24 | 21 | 17 | 27 | 25 | 22 | 18 |
| | ΔT | 0.92 | 0.91 | 0.91 | 0.92 | 1.02 | 1.01 | 1.01 | 1.02 | 1.13 | 1.13 | 1.13 | 1.13 | 1.25 | 1.25 | 1.25 | 1.25 | 1.38 | 1.38 | 1.38 | 1.39 | 1.54 | 1.54 | 1.54 | 1.55 |
| | kW | 3.0 | 3.0 | 3.0 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |
| | Amps | 18.0 | 18.3 | 18.8 | 19.6 | 17.9 | 18.1 | 18.7 | 19.5 | 17.4 | 17.7 | 18.2 | 19.0 | 16.6 | 16.9 | 17.4 | 18.2 | 15.7 | 15.9 | 16.4 | 17.2 | 14.8 | 15.0 | 15.6 | 16.4 |
| 630 | MBh | 1.00 | 0.87 | 0.73 | 0.6 | 1.00 | 0.87 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 | 1.00 | 1.00 | 0.80 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 |
| | S/T | 26 | 24 | 20 | 17 | 26 | 24 | 20 | 17 | 26 | 24 | 21 | 17 | 26 | 24 | 20 | 17 | 25 | 24 | 20 | 17 | 26 | 25 | 21 | 18 |
| | ΔT | 0.92 | 0.92 | 0.92 | 0.9 | 1.02 | 1.02 | 1.02 | 1.0 | 1.13 | 1.13 | 1.13 | 1.1 | 1.25 | 1.25 | 1.25 | 1.3 | 1.39 | 1.39 | 1.38 | 1.4 | 1.55 | 1.55 | 1.54 | 1.6 |
| | kW | 3.0 | 3.0 | 3.0 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |
| | Amps | 18.0 | 18.3 | 18.8 | 19.6 | 17.9 | 18.1 | 18.7 | 19.5 | 17.4 | 17.7 | 18.2 | 19.0 | 16.6 | 16.9 | 17.4 | 18.2 | 15.7 | 15.9 | 16.4 | 17.2 | 14.8 | 15.0 | 15.6 | 16.4 |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 85 | MBh | 17.9 | 18.1 | 18.7 | 19.5 | 17.7 | 18.0 | 18.5 | 19.3 | 17.3 | 17.5 | 18.0 | 18.8 | 16.5 | 16.7 | 17.3 | 18.1 | 15.5 | 15.8 | 16.3 | 17.1 | 14.6 | 14.9 | 15.4 | 16.2 |
| | S/T | 1.00 | 0.86 | 0.72 | 0.6 | 1.00 | 1.00 | 0.73 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.77 | 0.6 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 |
| | ΔT | 31 | 29 | 26 | 23 | 31 | 29 | 26 | 23 | 31 | 30 | 26 | 23 | 31 | 29 | 26 | 22 | 31 | 29 | 26 | 22 | 32 | 30 | 27 | 23 |
| | kW | 0.91 | 0.91 | 0.91 | 0.9 | 1.01 | 1.01 | 1.01 | 1.0 | 1.12 | 1.12 | 1.12 | 1.1 | 1.24 | 1.24 | 1.24 | 1.2 | 1.38 | 1.38 | 1.38 | 1.4 | 1.54 | 1.54 | 1.54 | 1.5 |
| | Amps | 2.9 | 2.9 | 2.9 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |
| 588 | MBh | 18.2 | 18.4 | 19.0 | 19.8 | 18.0 | 18.3 | 18.8 | 19.6 | 17.6 | 17.8 | 18.3 | 19.1 | 16.8 | 17.0 | 17.6 | 18.4 | 15.8 | 16.1 | 16.6 | 17.4 | 14.9 | 15.2 | 15.7 | 16.5 |
| | S/T | 1.00 | 0.95 | 0.81 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 30 | 28 | 25 | 21 | 30 | 28 | 24 | 21 | 30 | 28 | 25 | 21 | 30 | 28 | 24 | 21 | 29 | 28 | 24 | 21 | 30 | 29 | 25 | 22 |
| | kW | 0.92 | 0.92 | 0.91 | 0.92 | 1.02 | 1.02 | 1.01 | 1.02 | 1.13 | 1.13 | 1.13 | 1.13 | 1.25 | 1.25 | 1.25 | 1.26 | 1.39 | 1.39 | 1.38 | 1.39 | 1.55 | 1.54 | 1.54 | 1.55 |
| | Amps | 3.0 | 3.0 | 3.0 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |
| 630 | MBh | 18.3 | 18.6 | 19.1 | 19.9 | 18.2 | 18.4 | 19.0 | 19.8 | 17.7 | 18.0 | 18.5 | 19.3 | 16.9 | 17.2 | 17.7 | 18.5 | 16.0 | 16.2 | 16.7 | 17.5 | 15.1 | 15.3 | 15.9 | 16.7 |
| | S/T | 1.00 | 1.00 | 0.83 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 0.86 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 29 | 27 | 24 | 21 | 29 | 27 | 24 | 20 | 29 | 28 | 24 | 21 | 29 | 27 | 24 | 20 | 29 | 27 | 24 | 20 | 30 | 28 | 25 | 21 |
| | kW | 0.92 | 0.92 | 0.92 | 0.9 | 1.02 | 1.02 | 1.02 | 1.0 | 1.13 | 1.13 | 1.13 | 1.1 | 1.25 | 1.25 | 1.25 | 1.3 | 1.39 | 1.39 | 1.39 | 1.4 | 1.55 | 1.55 | 1.55 | 1.6 |
| | Amps | 3.0 | 3.0 | 3.0 | 3.0 | 3.4 | 3.4 | 3.4 | 3.4 | 3.9 | 3.9 | 3.9 | 3.9 | 4.4 | 4.4 | 4.4 | 4.5 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.7 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA3610**/CA*TA3626*3A*+EEP - HIGH STAGE

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|-----------------------------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|-------|----|----|----|--|--|-------|--|--|--|--|--|
| | | 65°F | | | | | | 75°F | | | | | | 85°F | | | | | | 95°F | | | | | | 105°F | | | | | | 115°F | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | | | | | |
| 70 | MBh | 36.1 | 36.6 | 37.6 | - | 35.8 | 36.3 | 37.3 | - | 34.8 | 35.3 | 36.4 | - | 33.2 | 33.7 | 34.8 | - | 31.3 | 31.8 | 32.8 | - | 29.5 | 30.0 | 31.1 | - | | | | | | | | | | | | |
| | S/T | 0.64 | 0.57 | 0.44 | - | 0.65 | 0.57 | 0.44 | - | 0.67 | 0.60 | 0.47 | - | 1.00 | 0.62 | 0.49 | - | 1.00 | 0.64 | 0.51 | - | 1.00 | 0.69 | 0.56 | - | | | | | | | | | | | | |
| | ΔT | 20 | 18 | 14 | - | 20 | 18 | 14 | - | 20 | 18 | 15 | - | 20 | 18 | 14 | - | 20 | 18 | 14 | - | 21 | 19 | 15 | - | | | | | | | | | | | | |
| | kW | 2.09 | 2.09 | 2.08 | - | 2.33 | 2.33 | 2.33 | - | 2.60 | 2.60 | 2.60 | - | 2.90 | 2.90 | 2.89 | - | 3.23 | 3.22 | 3.22 | - | 3.61 | 3.61 | 3.60 | - | | | | | | | | | | | | |
| | Amps | 6.9 | 6.9 | 6.9 | - | 8.0 | 8.0 | 8.0 | - | 9.2 | 9.2 | 9.1 | - | 10.4 | 10.4 | 10.4 | - | 11.9 | 11.9 | 11.8 | - | 13.5 | 13.5 | 13.5 | - | | | | | | | | | | | | |
| 1120 | MBh | 36.4 | 36.9 | 38.0 | - | 36.1 | 36.6 | 37.6 | - | 35.1 | 35.6 | 36.7 | - | 33.5 | 34.0 | 35.1 | - | 31.6 | 32.1 | 33.1 | - | 29.8 | 30.3 | 31.4 | - | | | | | | | | | | | | |
| | S/T | 0.66 | 0.59 | 0.46 | - | 0.67 | 0.59 | 0.46 | - | 0.69 | 0.62 | 0.49 | - | 1.00 | 0.64 | 0.51 | - | 1.00 | 0.66 | 0.53 | - | 1.00 | 0.71 | 0.58 | - | | | | | | | | | | | | |
| | ΔT | 19 | 17 | 14 | - | 19 | 17 | 14 | - | 19 | 18 | 14 | - | 19 | 17 | 14 | - | 19 | 17 | 13 | - | 20 | 18 | 15 | - | | | | | | | | | | | | |
| | kW | 2.10 | 2.09 | 2.09 | - | 2.34 | 2.34 | 2.33 | - | 2.61 | 2.61 | 2.60 | - | 2.90 | 2.90 | 2.90 | - | 3.23 | 3.23 | 3.23 | - | 3.62 | 3.61 | 3.61 | - | | | | | | | | | | | | |
| | Amps | 7.0 | 7.0 | 6.9 | - | 8.0 | 8.0 | 8.0 | - | 9.2 | 9.2 | 9.2 | - | 10.5 | 10.5 | 10.4 | - | 11.9 | 11.9 | 11.9 | - | 13.6 | 13.6 | 13.5 | - | | | | | | | | | | | | |
| 1350 | MBh | 37.1 | 37.6 | 38.6 | - | 36.7 | 37.2 | 38.3 | - | 35.8 | 36.3 | 37.4 | - | 34.2 | 34.7 | 35.8 | - | 32.3 | 32.8 | 33.8 | - | 30.5 | 31.0 | 32.0 | - | | | | | | | | | | | | |
| | S/T | 0.68 | 0.61 | 0.48 | - | 0.69 | 0.62 | 0.48 | - | 0.71 | 0.64 | 0.51 | - | 1.00 | 0.66 | 0.53 | - | 1.00 | 0.68 | 0.55 | - | 1.00 | 0.73 | 0.60 | - | | | | | | | | | | | | |
| | ΔT | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 19 | 17 | 13 | - | 18 | 16 | 13 | - | 18 | 16 | 12 | - | 19 | 17 | 14 | - | | | | | | | | | | | | |
| | kW | 2.11 | 2.10 | 2.10 | - | 2.35 | 2.35 | 2.34 | - | 2.62 | 2.62 | 2.61 | - | 2.91 | 2.91 | 2.91 | - | 3.24 | 3.24 | 3.24 | - | 3.63 | 3.62 | 3.62 | - | | | | | | | | | | | | |
| | Amps | 7.0 | 7.0 | 7.0 | - | 8.1 | 8.1 | 8.0 | - | 9.2 | 9.2 | 9.2 | - | 10.5 | 10.5 | 10.5 | - | 11.9 | 11.9 | 11.9 | - | 13.6 | 13.6 | 13.6 | - | | | | | | | | | | | | |

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------|----|----|----|--|--|-------|--|--|--|--|--|
| | | 65°F | | | | | | 75°F | | | | | | 85°F | | | | | | 95°F | | | | | | 105°F | | | | | | 115°F | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | | | | | |
| 75 | MBh | 36.1 | 36.6 | 37.7 | 39.3 | 35.8 | 36.3 | 37.3 | 39.0 | 34.8 | 35.4 | 36.4 | 38.0 | 33.2 | 33.8 | 34.8 | 36.4 | 31.3 | 31.8 | 32.9 | 34.5 | 29.5 | 30.0 | 31.1 | 32.7 | | | | | | | | | | | | |
| | S/T | 0.76 | 0.69 | 0.56 | 0.4 | 0.77 | 0.70 | 0.57 | 0.4 | 1.00 | 0.72 | 0.59 | 0.5 | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.76 | 0.63 | 0.5 | 1.00 | 1.00 | 0.68 | 0.5 | | | | | | | | | | | | |
| | ΔT | 24 | 22 | 19 | 15 | 24 | 22 | 19 | 15 | 24 | 22 | 19 | 15 | 24 | 22 | 18 | 15 | 24 | 22 | 18 | 14 | 25 | 23 | 19 | 16 | | | | | | | | | | | | |
| | kW | 2.09 | 2.09 | 2.08 | 2.1 | 2.33 | 2.33 | 2.32 | 2.3 | 2.60 | 2.60 | 2.60 | 2.6 | 2.90 | 2.89 | 2.89 | 2.9 | 3.22 | 3.22 | 3.22 | 3.2 | 3.61 | 3.61 | 3.60 | 3.6 | | | | | | | | | | | | |
| | Amps | 6.9 | 6.9 | 6.9 | 7.0 | 8.0 | 8.0 | 8.0 | 8.0 | 9.2 | 9.2 | 9.1 | 9.2 | 10.4 | 10.4 | 10.4 | 10.5 | 11.9 | 11.9 | 11.8 | 11.9 | 13.5 | 13.5 | 13.5 | 13.6 | | | | | | | | | | | | |
| 1200 | MBh | 36.4 | 36.9 | 38.0 | 39.6 | 36.1 | 36.6 | 37.7 | 39.3 | 35.2 | 35.7 | 36.7 | 38.3 | 33.6 | 34.1 | 35.1 | 36.7 | 31.6 | 32.1 | 33.2 | 34.8 | 29.8 | 30.3 | 31.4 | 33.0 | | | | | | | | | | | | |
| | S/T | 0.79 | 0.71 | 0.58 | 0.4 | 0.79 | 0.72 | 0.59 | 0.5 | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.76 | 0.63 | 0.5 | 1.00 | 0.78 | 0.65 | 0.5 | 1.00 | 1.00 | 0.70 | 0.6 | | | | | | | | | | | | |
| | ΔT | 24 | 22 | 18 | 14 | 24 | 22 | 18 | 14 | 24 | 22 | 18 | 14 | 23 | 22 | 18 | 14 | 23 | 21 | 18 | 14 | 24 | 22 | 19 | 15 | | | | | | | | | | | | |
| | kW | 2.09 | 2.09 | 2.09 | 2.11 | 2.34 | 2.34 | 2.33 | 2.35 | 2.61 | 2.61 | 2.60 | 2.62 | 2.90 | 2.90 | 2.90 | 2.91 | 3.23 | 3.23 | 3.22 | 3.24 | 3.61 | 3.61 | 3.61 | 3.63 | | | | | | | | | | | | |
| | Amps | 7.0 | 6.9 | 6.9 | 7.0 | 8.0 | 8.0 | 8.0 | 8.1 | 9.2 | 9.2 | 9.2 | 9.2 | 10.5 | 10.5 | 10.4 | 10.5 | 11.9 | 11.9 | 11.9 | 11.9 | 13.6 | 13.6 | 13.5 | 13.6 | | | | | | | | | | | | |
| 1350 | MBh | 37.1 | 37.6 | 38.6 | 40.3 | 36.8 | 37.3 | 38.3 | 40.0 | 35.8 | 36.3 | 37.4 | 39.0 | 34.2 | 34.7 | 35.8 | 37.4 | 32.3 | 32.8 | 33.8 | 35.5 | 30.5 | 31.0 | 32.1 | 33.7 | | | | | | | | | | | | |
| | S/T | 0.81 | 0.73 | 0.60 | 0.5 | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.76 | 0.63 | 0.5 | 1.00 | 0.78 | 0.65 | 0.5 | 1.00 | 0.80 | 0.67 | 0.5 | 1.00 | 1.00 | 0.72 | 0.6 | | | | | | | | | | | | |
| | ΔT | 23 | 21 | 17 | 13 | 23 | 21 | 17 | 13 | 23 | 21 | 17 | 13 | 23 | 21 | 17 | 13 | 22 | 20 | 17 | 13 | 23 | 22 | 18 | 14 | | | | | | | | | | | | |
| | kW | 2.10 | 2.10 | 2.10 | 2.1 | 2.35 | 2.35 | 2.34 | 2.4 | 2.62 | 2.62 | 2.61 | 2.6 | 2.91 | 2.91 | 2.91 | 2.9 | 3.24 | 3.24 | 3.23 | 3.3 | 3.63 | 3.62 | 3.62 | 3.6 | | | | | | | | | | | | |
| | Amps | 7.0 | 7.0 | 7.0 | 7.1 | 8.1 | 8.0 | 8.0 | 8.1 | 9.2 | 9.2 | 9.2 | 9.3 | 10.5 | 10.5 | 10.5 | 10.6 | 11.9 | 11.9 | 11.9 | 12.0 | 13.6 | 13.6 | 13.6 | 13.7 | | | | | | | | | | | | |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA3610**/CA*TA3626*3A*+EEP - HIGH STAGE (CONT.)

| IDB | AIREFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|------|----------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------------|------|-------|------|------|------|-------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 80 | MBh | 36.3 | 36.8 | 37.8 | 39.5 | 36.0 | 36.5 | 37.5 | 39.2 | 35.0 | 35.5 | 36.6 | 38.2 | 33.4 | 33.9 | 35.0 | 36.6 | 31.5 | 32.0 | 33.0 | 34.7 | 29.7 | 30.2 | 31.3 | 32.9 |
| | S/T | 1.00 | 0.81 | 0.68 | 0.5 | 1.00 | 0.82 | 0.69 | 0.6 | 1.00 | 0.84 | 0.71 | 0.6 | 1.00 | 1.00 | 0.73 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 | 1.00 | 1.00 | 0.80 | 0.7 |
| | ΔT | 28 | 26 | 23 | 19 | 28 | 26 | 23 | 19 | 29 | 27 | 23 | 19 | 28 | 26 | 23 | 19 | 28 | 26 | 23 | 19 | 29 | 27 | 24 | 20 |
| | kW | 2.09 | 2.09 | 2.08 | 2.1 | 2.33 | 2.33 | 2.33 | 2.3 | 2.60 | 2.60 | 2.60 | 2.6 | 2.90 | 2.89 | 2.89 | 2.9 | 3.22 | 3.22 | 3.22 | 3.2 | 3.61 | 3.61 | 3.60 | 3.6 |
| | Amps | 6.9 | 6.9 | 6.9 | 7.0 | 8.0 | 8.0 | 8.0 | 8.0 | 9.2 | 9.2 | 9.1 | 9.2 | 10.4 | 10.4 | 10.4 | 10.5 | 11.9 | 11.9 | 11.8 | 11.9 | 13.5 | 13.5 | 13.5 | 13.6 |
| 80 | MBh | 36.6 | 37.1 | 38.2 | 39.8 | 36.3 | 36.8 | 37.8 | 39.5 | 35.3 | 35.8 | 36.9 | 38.5 | 33.7 | 34.2 | 35.3 | 36.9 | 31.8 | 32.3 | 33.4 | 35.0 | 30.0 | 30.5 | 31.6 | 33.2 |
| | S/T | 1.00 | 0.83 | 0.70 | 0.6 | 1.00 | 0.84 | 0.71 | 0.6 | 1.00 | 0.86 | 0.73 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 | 1.00 | 1.00 | 0.77 | 0.6 | 1.00 | 1.00 | 0.82 | 0.7 |
| | ΔT | 28 | 26 | 22 | 19 | 28 | 26 | 22 | 18 | 28 | 26 | 23 | 19 | 28 | 26 | 22 | 18 | 28 | 26 | 22 | 18 | 29 | 27 | 23 | 19 |
| | kW | 2.10 | 2.09 | 2.09 | 2.11 | 2.34 | 2.34 | 2.33 | 2.35 | 2.61 | 2.61 | 2.60 | 2.62 | 2.90 | 2.90 | 2.90 | 2.92 | 3.23 | 3.23 | 3.23 | 3.24 | 3.62 | 3.61 | 3.61 | 3.63 |
| | Amps | 7.0 | 7.0 | 6.9 | 7.0 | 8.0 | 8.0 | 8.0 | 8.1 | 9.2 | 9.2 | 9.2 | 9.3 | 10.5 | 10.5 | 10.4 | 10.5 | 11.9 | 11.9 | 11.9 | 12.0 | 13.6 | 13.6 | 13.5 | 13.6 |
| 1350 | MBh | 37.3 | 37.8 | 38.8 | 40.5 | 36.9 | 37.4 | 38.5 | 40.1 | 36.0 | 36.5 | 37.6 | 39.2 | 34.4 | 34.9 | 36.0 | 37.6 | 32.5 | 33.0 | 34.0 | 35.7 | 30.7 | 31.2 | 32.2 | 33.9 |
| | S/T | 1.00 | 0.85 | 0.72 | 0.6 | 1.00 | 0.86 | 0.73 | 0.6 | 1.00 | 0.88 | 0.75 | 0.6 | 1.00 | 1.00 | 0.77 | 0.6 | 1.00 | 1.00 | 0.79 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 |
| | ΔT | 27 | 25 | 21 | 18 | 27 | 25 | 21 | 17 | 27 | 25 | 22 | 18 | 27 | 25 | 21 | 17 | 27 | 25 | 21 | 17 | 28 | 26 | 22 | 18 |
| | kW | 2.11 | 2.10 | 2.10 | 2.1 | 2.35 | 2.35 | 2.34 | 2.4 | 2.62 | 2.62 | 2.61 | 2.6 | 2.91 | 2.91 | 2.91 | 2.9 | 3.24 | 3.24 | 3.24 | 3.3 | 3.63 | 3.62 | 3.62 | 3.6 |
| | Amps | 7.0 | 7.0 | 7.0 | 7.1 | 8.1 | 8.1 | 8.0 | 8.1 | 9.2 | 9.2 | 9.2 | 9.3 | 10.5 | 10.5 | 10.5 | 10.6 | 11.9 | 11.9 | 11.9 | 12.0 | 13.6 | 13.6 | 13.6 | 13.7 |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------------|------|------|------|------|------|------|------|------|------|------|
| 85 | MBh | 36.9 | 37.4 | 38.4 | 40.1 | 36.6 | 37.1 | 38.1 | 39.8 | 35.6 | 36.1 | 37.2 | 38.8 | 34.0 | 34.5 | 35.6 | 37.2 | 32.1 | 32.6 | 33.6 | 35.3 | 30.3 | 30.8 | 31.9 | 33.5 |
| | S/T | 1.00 | 0.91 | 0.78 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 | 1.00 | 1.00 | 0.81 | 0.7 | 1.00 | 1.00 | 0.83 | 0.7 | 1.00 | 1.00 | 0.85 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 32 | 30 | 27 | 23 | 32 | 30 | 27 | 23 | 32 | 31 | 27 | 23 | 32 | 30 | 27 | 23 | 32 | 30 | 26 | 23 | 33 | 31 | 28 | 24 |
| | kW | 2.09 | 2.09 | 2.09 | 2.1 | 2.34 | 2.33 | 2.33 | 2.3 | 2.61 | 2.61 | 2.60 | 2.6 | 2.90 | 2.90 | 2.90 | 2.9 | 3.23 | 3.23 | 3.22 | 3.2 | 3.61 | 3.61 | 3.61 | 3.6 |
| | Amps | 7.0 | 6.9 | 6.9 | 7.0 | 8.0 | 8.0 | 8.0 | 8.1 | 9.2 | 9.2 | 9.2 | 9.2 | 10.5 | 10.5 | 10.4 | 10.5 | 11.9 | 11.9 | 11.9 | 11.9 | 13.6 | 13.6 | 13.5 | 13.6 |
| 1200 | MBh | 37.2 | 37.7 | 38.8 | 40.4 | 36.9 | 37.4 | 38.4 | 40.1 | 35.9 | 36.4 | 37.5 | 39.1 | 34.3 | 34.8 | 35.9 | 37.5 | 32.4 | 32.9 | 34.0 | 35.6 | 30.6 | 31.1 | 32.2 | 33.8 |
| | S/T | 1.00 | 0.93 | 0.80 | 0.7 | 1.00 | 1.00 | 0.81 | 0.7 | 1.00 | 1.00 | 0.83 | 0.7 | 1.00 | 1.00 | 0.85 | 0.7 | 1.00 | 1.00 | 0.87 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 32 | 30 | 26 | 22 | 32 | 30 | 26 | 22 | 32 | 30 | 26 | 23 | 32 | 30 | 26 | 22 | 31 | 29 | 26 | 22 | 33 | 31 | 27 | 23 |
| | kW | 2.10 | 2.10 | 2.09 | 2.11 | 2.34 | 2.34 | 2.34 | 2.36 | 2.61 | 2.61 | 2.61 | 2.63 | 2.91 | 2.91 | 2.90 | 2.92 | 3.24 | 3.23 | 3.23 | 3.25 | 3.62 | 3.62 | 3.61 | 3.63 |
| | Amps | 7.0 | 7.0 | 7.0 | 7.0 | 8.0 | 8.0 | 8.0 | 8.1 | 9.2 | 9.2 | 9.2 | 9.3 | 10.5 | 10.5 | 10.5 | 10.5 | 11.9 | 11.9 | 11.9 | 12.0 | 13.6 | 13.6 | 13.6 | 13.6 |
| 1350 | MBh | 37.9 | 38.4 | 39.4 | 41.1 | 37.5 | 38.0 | 39.1 | 40.7 | 36.6 | 37.1 | 38.2 | 39.8 | 35.0 | 35.5 | 36.6 | 38.2 | 33.1 | 33.6 | 34.6 | 36.3 | 31.3 | 31.8 | 32.8 | 34.5 |
| | S/T | 1.00 | 0.95 | 0.82 | 0.7 | 1.00 | 1.00 | 0.83 | 0.7 | 1.00 | 1.00 | 0.85 | 0.7 | 1.00 | 1.00 | 0.87 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 31 | 29 | 25 | 21 | 31 | 29 | 25 | 21 | 31 | 29 | 25 | 22 | 31 | 29 | 25 | 21 | 30 | 28 | 25 | 21 | 32 | 30 | 26 | 22 |
| | kW | 2.11 | 2.11 | 2.10 | 2.1 | 2.35 | 2.35 | 2.35 | 2.4 | 2.62 | 2.62 | 2.62 | 2.6 | 2.92 | 2.92 | 2.91 | 2.9 | 3.25 | 3.24 | 3.24 | 3.3 | 3.63 | 3.63 | 3.62 | 3.6 |
| | Amps | 7.0 | 7.0 | 7.0 | 7.1 | 8.1 | 8.1 | 8.1 | 8.1 | 9.3 | 9.3 | 9.2 | 9.3 | 10.5 | 10.5 | 10.5 | 10.6 | 12.0 | 12.0 | 11.9 | 12.0 | 13.6 | 13.6 | 13.6 | 13.7 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA3610**/CA*TA3626*3A*+EEP - LOW STAGE

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|------|--------------------------------------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|-------|------|------|----|-------|------|------|----|----|----|----|----|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | |
| | | ENTERING INDOOR WET BULB TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| AIRFLOW | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 70 | MBh | 25.8 | 26.1 | 26.9 | - | 25.5 | 25.9 | 26.6 | - | 24.9 | 25.2 | 26.0 | - | 23.7 | 24.1 | 24.8 | - | 22.3 | 22.7 | 23.4 | - | 21.0 | 21.4 | 22.1 | - | | | | |
| | S/T | 0.63 | 0.55 | 0.42 | - | 0.64 | 0.56 | 0.43 | - | 0.66 | 0.59 | 0.45 | - | 1.00 | 0.60 | 0.47 | - | 1.00 | 0.63 | 0.49 | - | 1.00 | 0.68 | 0.54 | - | | | | |
| | ΔT | 20 | 18 | 14 | - | 20 | 18 | 14 | - | 20 | 18 | 15 | - | 20 | 18 | 14 | - | 19 | 18 | 14 | - | 21 | 19 | 15 | - | | | | |
| | kW | 1.31 | 1.31 | 1.31 | - | 1.46 | 1.46 | 1.46 | - | 1.63 | 1.63 | 1.63 | - | 1.82 | 1.82 | 1.81 | - | 2.02 | 2.02 | 2.02 | - | 2.27 | 2.27 | 2.26 | - | | | | |
| | Amps | 4.3 | 4.3 | 4.3 | - | 5.0 | 5.0 | 5.0 | - | 5.8 | 5.7 | 5.7 | - | 6.6 | 6.5 | 6.5 | - | 7.5 | 7.4 | 7.4 | - | 8.5 | 8.5 | 8.5 | - | | | | |
| 840 | MBh | 25.9 | 26.3 | 27.1 | - | 25.7 | 26.1 | 26.8 | - | 25.0 | 25.4 | 26.2 | - | 23.9 | 24.3 | 25.0 | - | 22.5 | 22.8 | 23.6 | - | 21.2 | 21.6 | 22.3 | - | | | | |
| | S/T | 0.66 | 0.58 | 0.45 | - | 0.66 | 0.59 | 0.45 | - | 0.69 | 0.61 | 0.48 | - | 1.00 | 0.63 | 0.50 | - | 1.00 | 0.65 | 0.52 | - | 1.00 | 0.71 | 0.57 | - | | | | |
| | ΔT | 19 | 17 | 14 | - | 19 | 17 | 14 | - | 19 | 17 | 14 | - | 19 | 17 | 14 | - | 19 | 17 | 13 | - | 20 | 18 | 15 | - | | | | |
| | kW | 1.31 | 1.31 | 1.31 | - | 1.47 | 1.47 | 1.46 | - | 1.64 | 1.64 | 1.63 | - | 1.82 | 1.82 | 1.82 | - | 2.03 | 2.03 | 2.02 | - | 2.27 | 2.27 | 2.27 | - | | | | |
| | Amps | 4.4 | 4.4 | 4.3 | - | 5.0 | 5.0 | 5.0 | - | 5.8 | 5.8 | 5.8 | - | 6.6 | 6.6 | 6.6 | - | 7.5 | 7.5 | 7.5 | - | 8.5 | 8.5 | 8.5 | - | | | | |
| 945 | MBh | 26.3 | 26.7 | 27.5 | - | 26.1 | 26.5 | 27.2 | - | 25.4 | 25.8 | 26.6 | - | 24.3 | 24.7 | 25.4 | - | 22.9 | 23.3 | 24.0 | - | 21.6 | 22.0 | 22.7 | - | | | | |
| | S/T | 0.69 | 0.62 | 0.48 | - | 0.70 | 0.62 | 0.49 | - | 1.00 | 0.65 | 0.51 | - | 1.00 | 0.67 | 0.53 | - | 1.00 | 0.69 | 0.55 | - | 1.00 | 1.00 | 0.60 | - | | | | |
| | ΔT | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 18 | 17 | 13 | - | 18 | 16 | 13 | - | 18 | 16 | 13 | - | 19 | 17 | 14 | - | | | | |
| | kW | 1.32 | 1.32 | 1.32 | - | 1.47 | 1.47 | 1.47 | - | 1.64 | 1.64 | 1.64 | - | 1.83 | 1.83 | 1.83 | - | 2.04 | 2.03 | 2.03 | - | 2.28 | 2.28 | 2.27 | - | | | | |
| | Amps | 4.4 | 4.4 | 4.4 | - | 5.1 | 5.1 | 5.0 | - | 5.8 | 5.8 | 5.8 | - | 6.6 | 6.6 | 6.6 | - | 7.5 | 7.5 | 7.5 | - | 8.6 | 8.5 | 8.5 | - | | | | |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 75 | MBh | 25.8 | 26.1 | 26.9 | 28.1 | 25.5 | 25.9 | 26.7 | 27.8 | 24.9 | 25.2 | 26.0 | 27.2 | 23.7 | 24.1 | 24.8 | 26.0 | 22.3 | 22.7 | 23.4 | 24.6 | 21.0 | 21.4 | 22.2 | 23.3 |
| | S/T | 0.76 | 0.68 | 0.55 | 0.4 | 1.00 | 0.69 | 0.55 | 0.4 | 1.00 | 0.71 | 0.58 | 0.4 | 1.00 | 0.73 | 0.60 | 0.5 | 1.00 | 0.75 | 0.62 | 0.5 | 1.00 | 1.00 | 0.67 | 0.5 |
| | ΔT | 24 | 22 | 18 | 15 | 24 | 22 | 18 | 15 | 24 | 22 | 19 | 15 | 24 | 22 | 18 | 15 | 24 | 22 | 18 | 15 | 25 | 23 | 19 | 16 |
| | kW | 1.31 | 1.31 | 1.31 | 1.3 | 1.46 | 1.46 | 1.46 | 1.5 | 1.63 | 1.63 | 1.63 | 1.6 | 1.82 | 1.82 | 1.81 | 1.8 | 2.02 | 2.02 | 2.02 | 2.0 | 2.27 | 2.26 | 2.26 | 2.3 |
| | Amps | 4.3 | 4.3 | 4.3 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.7 | 5.7 | 5.7 | 5.8 | 6.6 | 6.5 | 6.5 | 6.6 | 7.4 | 7.4 | 7.4 | 7.5 | 8.5 | 8.5 | 8.5 | 8.5 |
| 1200 | MBh | 26.0 | 26.3 | 27.1 | 28.2 | 25.7 | 26.1 | 26.9 | 28.0 | 25.1 | 25.4 | 26.2 | 27.4 | 23.9 | 24.3 | 25.0 | 26.2 | 22.5 | 22.9 | 23.6 | 24.8 | 21.2 | 21.6 | 22.3 | 23.5 |
| | S/T | 0.79 | 0.71 | 0.58 | 0.4 | 1.00 | 0.72 | 0.58 | 0.4 | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.76 | 0.63 | 0.5 | 1.00 | 1.00 | 0.65 | 0.5 | 1.00 | 1.00 | 0.70 | 0.6 |
| | ΔT | 23 | 21 | 18 | 14 | 23 | 21 | 18 | 14 | 24 | 22 | 18 | 14 | 23 | 21 | 18 | 14 | 23 | 21 | 18 | 14 | 24 | 22 | 19 | 15 |
| | kW | 1.31 | 1.31 | 1.31 | 1.32 | 1.47 | 1.46 | 1.46 | 1.47 | 1.64 | 1.64 | 1.63 | 1.64 | 1.82 | 1.82 | 1.82 | 1.83 | 2.03 | 2.03 | 2.02 | 2.04 | 2.27 | 2.27 | 2.27 | 2.28 |
| | Amps | 4.4 | 4.4 | 4.3 | 4.4 | 5.0 | 5.0 | 5.0 | 5.1 | 5.8 | 5.8 | 5.7 | 5.8 | 6.6 | 6.6 | 6.6 | 6.6 | 7.5 | 7.5 | 7.4 | 7.5 | 8.5 | 8.5 | 8.5 | 8.6 |
| 1350 | MBh | 26.4 | 26.7 | 27.5 | 28.7 | 26.1 | 26.5 | 27.3 | 28.4 | 25.5 | 25.8 | 26.6 | 27.8 | 24.3 | 24.7 | 25.4 | 26.6 | 22.9 | 23.3 | 24.0 | 25.2 | 21.6 | 22.0 | 22.7 | 23.9 |
| | S/T | 0.82 | 0.74 | 0.61 | 0.5 | 1.00 | 0.75 | 0.62 | 0.5 | 1.00 | 0.77 | 0.64 | 0.5 | 1.00 | 0.79 | 0.66 | 0.5 | 1.00 | 1.00 | 0.68 | 0.5 | 1.00 | 1.00 | 0.73 | 0.6 |
| | ΔT | 22 | 20 | 17 | 13 | 22 | 20 | 17 | 13 | 23 | 21 | 17 | 14 | 22 | 20 | 17 | 13 | 22 | 20 | 17 | 13 | 23 | 21 | 18 | 14 |
| | kW | 1.32 | 1.32 | 1.32 | 1.3 | 1.47 | 1.47 | 1.47 | 1.5 | 1.64 | 1.64 | 1.64 | 1.7 | 1.83 | 1.83 | 1.82 | 1.8 | 2.03 | 2.03 | 2.03 | 2.0 | 2.28 | 2.28 | 2.27 | 2.3 |
| | Amps | 4.4 | 4.4 | 4.4 | 4.4 | 5.1 | 5.0 | 5.0 | 5.1 | 5.8 | 5.8 | 5.8 | 5.8 | 6.6 | 6.6 | 6.6 | 6.6 | 7.5 | 7.5 | 7.5 | 7.5 | 8.5 | 8.5 | 8.5 | 8.6 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA3610**/CA*TA3626*3A*+EEP - LOW STAGE (CONT.)

| IDB | AIREFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|------------|----------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------------|------|-------|------|------|------|-------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 80 | MBh | 25.9 | 26.3 | 27.0 | 28.2 | 25.7 | 26.0 | 26.8 | 28.0 | 25.0 | 25.4 | 26.1 | 27.3 | 23.9 | 24.2 | 25.0 | 26.1 | 22.4 | 22.8 | 23.6 | 24.7 | 21.2 | 21.5 | 22.3 | 23.5 |
| | S/T | 1.00 | 0.81 | 0.67 | 0.5 | 1.00 | 0.81 | 0.68 | 0.5 | 1.00 | 0.84 | 0.70 | 0.6 | 1.00 | 1.00 | 0.72 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | 1.00 | 1.00 | 0.79 | 0.7 |
| | ΔT | 28 | 26 | 23 | 19 | 28 | 26 | 23 | 19 | 28 | 26 | 23 | 19 | 28 | 26 | 23 | 19 | 28 | 26 | 22 | 19 | 29 | 27 | 23 | 20 |
| | kW | 1.31 | 1.31 | 1.31 | 1.3 | 1.46 | 1.46 | 1.46 | 1.5 | 1.63 | 1.63 | 1.63 | 1.6 | 1.82 | 1.82 | 1.81 | 1.8 | 2.02 | 2.02 | 2.02 | 2.0 | 2.27 | 2.27 | 2.26 | 2.3 |
| | Amps | 4.3 | 4.3 | 4.3 | 4.4 | 5.0 | 5.0 | 5.0 | 5.0 | 5.8 | 5.7 | 5.7 | 5.8 | 6.6 | 6.5 | 6.5 | 6.6 | 7.5 | 7.4 | 7.4 | 7.5 | 8.5 | 8.5 | 8.5 | 8.5 |
| 840 | MBh | 26.1 | 26.4 | 27.2 | 28.4 | 25.9 | 26.2 | 27.0 | 28.2 | 25.2 | 25.6 | 26.3 | 27.5 | 24.0 | 24.4 | 25.2 | 26.3 | 22.6 | 23.0 | 23.8 | 24.9 | 21.3 | 21.7 | 22.5 | 23.6 |
| | S/T | 1.00 | 0.83 | 0.70 | 0.6 | 1.00 | 0.84 | 0.71 | 0.6 | 1.00 | 0.86 | 0.73 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 | 1.00 | 1.00 | 0.77 | 0.6 | 1.00 | 1.00 | 0.82 | 0.7 |
| | ΔT | 27 | 26 | 22 | 18 | 27 | 26 | 22 | 18 | 28 | 26 | 22 | 19 | 27 | 25 | 22 | 18 | 27 | 25 | 22 | 18 | 28 | 26 | 23 | 19 |
| | kW | 1.31 | 1.31 | 1.31 | 1.32 | 1.47 | 1.47 | 1.46 | 1.47 | 1.64 | 1.64 | 1.63 | 1.65 | 1.82 | 1.82 | 1.82 | 1.83 | 2.03 | 2.03 | 2.02 | 2.04 | 2.27 | 2.27 | 2.27 | 2.28 |
| | Amps | 4.4 | 4.4 | 4.3 | 4.4 | 5.0 | 5.0 | 5.0 | 5.1 | 5.8 | 5.8 | 5.8 | 5.8 | 6.6 | 6.6 | 6.6 | 6.6 | 7.5 | 7.5 | 7.5 | 7.5 | 8.5 | 8.5 | 8.5 | 8.6 |
| 945 | MBh | 26.5 | 26.9 | 27.6 | 28.8 | 26.3 | 26.6 | 27.4 | 28.6 | 25.6 | 26.0 | 26.7 | 27.9 | 24.4 | 24.8 | 25.6 | 26.7 | 23.0 | 23.4 | 24.2 | 25.3 | 21.8 | 22.1 | 22.9 | 24.0 |
| | S/T | 1.00 | 0.87 | 0.73 | 0.6 | 1.00 | 0.87 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 | 1.00 | 1.00 | 0.81 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 |
| | ΔT | 26 | 25 | 21 | 17 | 26 | 25 | 21 | 17 | 27 | 25 | 21 | 18 | 26 | 25 | 21 | 17 | 26 | 24 | 21 | 17 | 27 | 25 | 22 | 18 |
| | kW | 1.32 | 1.32 | 1.32 | 1.3 | 1.47 | 1.47 | 1.47 | 1.5 | 1.64 | 1.64 | 1.64 | 1.7 | 1.83 | 1.83 | 1.82 | 1.8 | 2.04 | 2.03 | 2.03 | 2.0 | 2.28 | 2.28 | 2.27 | 2.3 |
| | Amps | 4.4 | 4.4 | 4.4 | 4.4 | 5.1 | 5.1 | 5.0 | 5.1 | 5.8 | 5.8 | 5.8 | 5.8 | 6.6 | 6.6 | 6.6 | 6.6 | 7.5 | 7.5 | 7.5 | 7.5 | 8.5 | 8.5 | 8.5 | 8.6 |

| IDB | AIREFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|------------|----------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------|------|------|------|-------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 85 | MBh | 26.3 | 26.7 | 27.5 | 28.6 | 26.1 | 26.5 | 27.2 | 28.4 | 25.4 | 25.8 | 26.6 | 27.7 | 24.3 | 24.6 | 25.4 | 26.6 | 22.9 | 23.2 | 24.0 | 25.2 | 21.6 | 22.0 | 22.7 | 23.9 |
| | S/T | 1.00 | 0.91 | 0.77 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 | 1.00 | 1.00 | 0.80 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 32 | 30 | 26 | 23 | 32 | 30 | 26 | 23 | 32 | 30 | 27 | 23 | 32 | 30 | 26 | 23 | 31 | 30 | 26 | 22 | 33 | 31 | 27 | 24 |
| | kW | 1.31 | 1.31 | 1.31 | 1.3 | 1.47 | 1.46 | 1.46 | 1.5 | 1.64 | 1.64 | 1.63 | 1.6 | 1.82 | 1.82 | 1.82 | 1.8 | 2.03 | 2.03 | 2.02 | 2.0 | 2.27 | 2.27 | 2.27 | 2.3 |
| | Amps | 4.4 | 4.4 | 4.3 | 4.4 | 5.0 | 5.0 | 5.0 | 5.1 | 5.8 | 5.8 | 5.7 | 5.8 | 6.6 | 6.6 | 6.5 | 6.6 | 7.5 | 7.5 | 7.4 | 7.5 | 8.5 | 8.5 | 8.5 | 8.6 |
| 840 | MBh | 26.5 | 26.9 | 27.6 | 28.8 | 26.3 | 26.6 | 27.4 | 28.6 | 25.6 | 26.0 | 26.7 | 27.9 | 24.5 | 24.8 | 25.6 | 26.8 | 23.1 | 23.4 | 24.2 | 25.4 | 21.8 | 22.1 | 22.9 | 24.1 |
| | S/T | 1.00 | 0.93 | 0.80 | 0.7 | 1.00 | 1.00 | 0.81 | 0.7 | 1.00 | 1.00 | 0.83 | 0.7 | 1.00 | 1.00 | 0.85 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 31 | 29 | 26 | 22 | 31 | 29 | 26 | 22 | 31 | 29 | 26 | 22 | 31 | 29 | 26 | 22 | 31 | 29 | 25 | 22 | 32 | 30 | 27 | 23 |
| | kW | 1.32 | 1.32 | 1.31 | 1.32 | 1.47 | 1.47 | 1.47 | 1.48 | 1.64 | 1.64 | 1.64 | 1.65 | 1.83 | 1.82 | 1.82 | 1.83 | 2.03 | 2.03 | 2.03 | 2.04 | 2.27 | 2.27 | 2.27 | 2.28 |
| | Amps | 4.4 | 4.4 | 4.4 | 4.4 | 5.0 | 5.0 | 5.0 | 5.1 | 5.8 | 5.8 | 5.8 | 5.8 | 6.6 | 6.6 | 6.6 | 6.6 | 7.5 | 7.5 | 7.5 | 7.5 | 8.5 | 8.5 | 8.5 | 8.6 |
| 945 | MBh | 26.9 | 27.3 | 28.0 | 29.2 | 26.7 | 27.1 | 27.8 | 29.0 | 26.0 | 26.4 | 27.2 | 28.3 | 24.9 | 25.2 | 26.0 | 27.2 | 23.5 | 23.8 | 24.6 | 25.8 | 22.2 | 22.5 | 23.3 | 24.5 |
| | S/T | 1.00 | 0.97 | 0.83 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 0.86 | 0.7 | 1.00 | 1.00 | 0.88 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 30 | 28 | 25 | 21 | 30 | 28 | 25 | 21 | 30 | 29 | 25 | 21 | 30 | 28 | 25 | 21 | 30 | 28 | 24 | 21 | 31 | 29 | 26 | 22 |
| | kW | 1.32 | 1.32 | 1.32 | 1.3 | 1.48 | 1.48 | 1.47 | 1.5 | 1.65 | 1.65 | 1.64 | 1.7 | 1.83 | 1.83 | 1.83 | 1.8 | 2.04 | 2.04 | 2.03 | 2.0 | 2.28 | 2.28 | 2.28 | 2.3 |
| | Amps | 4.4 | 4.4 | 4.4 | 4.4 | 5.1 | 5.1 | 5.1 | 5.1 | 5.8 | 5.8 | 5.8 | 5.8 | 6.6 | 6.6 | 6.6 | 6.6 | 7.5 | 7.5 | 7.5 | 7.5 | 8.6 | 8.6 | 8.6 | 8.6 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA4810**/CA*TA6030*3A*+EEP - HIGH STAGE

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|--------------------------------------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|-------|----|----|----|--|--|-------|--|--|--|--|--|
| | | 65°F | | | | | | 75°F | | | | | | 85°F | | | | | | 95°F | | | | | | 105°F | | | | | | 115°F | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | | | | | |
| | | ENTERING INDOOR WET BULB TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | AIRFLOW | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1400 | MBh | 48.4 | 49.1 | 50.5 | - | 48.0 | 48.7 | 50.1 | - | 46.8 | 47.4 | 48.9 | - | 44.6 | 45.3 | 46.7 | - | 42.0 | 42.7 | 44.1 | - | 39.6 | 40.3 | 41.7 | - | | | | | | | | | | | | |
| | S/T | 0.61 | 0.54 | 0.41 | - | 0.61 | 0.54 | 0.42 | - | 0.63 | 0.56 | 0.44 | - | 0.65 | 0.58 | 0.46 | - | 0.67 | 0.60 | 0.48 | - | 1.00 | 0.65 | 0.53 | - | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | | | | | | | | | | | | |
| | kW | 2.88 | 2.88 | 2.87 | - | 3.20 | 3.20 | 3.20 | - | 3.56 | 3.56 | 3.56 | - | 3.95 | 3.95 | 3.95 | - | 4.39 | 4.39 | 4.38 | - | 4.90 | 4.90 | 4.89 | - | | | | | | | | | | | | |
| | Amps | 9.9 | 9.9 | 9.8 | - | 11.3 | 11.3 | 11.2 | - | 12.8 | 12.8 | 12.8 | - | 14.5 | 14.5 | 14.5 | - | 16.4 | 16.4 | 16.4 | - | 18.7 | 18.6 | 18.6 | - | | | | | | | | | | | | |
| 70 | MBh | 49.3 | 50.0 | 51.4 | - | 48.9 | 49.6 | 51.0 | - | 47.6 | 48.3 | 49.7 | - | 45.5 | 46.2 | 47.6 | - | 42.9 | 43.5 | 45.0 | - | 40.5 | 41.1 | 42.6 | - | | | | | | | | | | | | |
| | S/T | 0.64 | 0.57 | 0.45 | - | 0.64 | 0.58 | 0.45 | - | 0.67 | 0.60 | 0.47 | - | 0.68 | 0.62 | 0.49 | - | 1.00 | 0.64 | 0.51 | - | 1.00 | 0.68 | 0.56 | - | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | | | | | | | | | | | | |
| | kW | 2.90 | 2.89 | 2.89 | - | 3.22 | 3.22 | 3.21 | - | 3.58 | 3.58 | 3.57 | - | 3.97 | 3.97 | 3.96 | - | 4.41 | 4.40 | 4.40 | - | 4.92 | 4.91 | 4.91 | - | | | | | | | | | | | | |
| | Amps | 9.9 | 9.9 | 9.9 | - | 11.3 | 11.3 | 11.3 | - | 12.9 | 12.9 | 12.9 | - | 14.6 | 14.6 | 14.6 | - | 16.5 | 16.5 | 16.5 | - | 18.7 | 18.7 | 18.7 | - | | | | | | | | | | | | |
| 1800 | MBh | 50.4 | 51.1 | 52.5 | - | 50.0 | 50.6 | 52.1 | - | 48.7 | 49.4 | 50.8 | - | 46.6 | 47.2 | 48.7 | - | 43.9 | 44.6 | 46.0 | - | 41.5 | 42.2 | 43.7 | - | | | | | | | | | | | | |
| | S/T | 0.65 | 0.58 | 0.45 | - | 0.65 | 0.58 | 0.46 | - | 0.67 | 0.60 | 0.48 | - | 0.69 | 0.62 | 0.50 | - | 1.00 | 0.64 | 0.52 | - | 1.00 | 0.69 | 0.57 | - | | | | | | | | | | | | |
| | ΔT | 1 | 0 | 0 | - | 1 | 0 | 0 | - | 1 | 0 | 0 | - | 1 | 0 | 0 | - | 1 | 0 | 0 | - | 1 | 1 | 0 | - | | | | | | | | | | | | |
| | kW | 2.91 | 2.91 | 2.90 | - | 3.23 | 3.23 | 3.23 | - | 3.59 | 3.59 | 3.59 | - | 3.98 | 3.98 | 3.98 | - | 4.42 | 4.42 | 4.41 | - | 4.93 | 4.93 | 4.92 | - | | | | | | | | | | | | |
| | Amps | 10.0 | 10.0 | 10.0 | - | 11.4 | 11.4 | 11.4 | - | 13.0 | 13.0 | 12.9 | - | 14.7 | 14.7 | 14.6 | - | 16.6 | 16.6 | 16.5 | - | 18.8 | 18.8 | 18.8 | - | | | | | | | | | | | | |

| | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 1400 | MBh | 48.5 | 49.1 | 50.6 | 52.8 | 48.0 | 48.7 | 50.1 | 52.3 | 46.8 | 47.5 | 48.9 | 51.1 | 44.6 | 45.3 | 46.8 | 48.9 | 42.0 | 42.7 | 44.1 | 46.3 | 39.6 | 40.3 | 41.7 | 43.9 | |
| | S/T | 0.72 | 0.65 | 0.53 | 0.4 | 0.73 | 0.66 | 0.54 | 0.4 | 0.75 | 0.68 | 0.56 | 0.4 | 1.00 | 0.70 | 0.58 | 0.4 | 1.00 | 0.72 | 0.60 | 0.5 | 1.00 | 0.77 | 0.64 | 0.5 | |
| | ΔT | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | |
| | kW | 2.88 | 2.88 | 2.87 | 2.9 | 3.20 | 3.20 | 3.19 | 3.2 | 3.23 | 3.56 | 3.56 | 3.55 | 3.6 | 3.95 | 3.95 | 3.94 | 4.0 | 4.39 | 4.39 | 4.38 | 4.4 | 4.90 | 4.90 | 4.89 | 4.9 |
| | Amps | 9.9 | 9.9 | 9.8 | 9.9 | 11.3 | 11.3 | 11.2 | 11.3 | 11.3 | 12.8 | 12.8 | 12.8 | 12.9 | 14.5 | 14.5 | 14.5 | 14.6 | 16.4 | 16.4 | 16.4 | 16.5 | 18.6 | 18.6 | 18.6 | 18.7 |
| 1600 | MBh | 49.3 | 50.0 | 51.5 | 53.6 | 48.9 | 49.6 | 51.0 | 53.2 | 47.7 | 48.3 | 49.8 | 52.0 | 45.5 | 46.2 | 47.6 | 49.8 | 42.9 | 43.6 | 45.0 | 47.2 | 40.5 | 41.2 | 42.6 | 44.8 | |
| | S/T | 0.76 | 0.69 | 0.56 | 0.4 | 0.76 | 0.69 | 0.57 | 0.4 | 0.78 | 0.72 | 0.59 | 0.5 | 1.00 | 0.73 | 0.61 | 0.5 | 1.00 | 0.75 | 0.63 | 0.5 | 1.00 | 0.80 | 0.68 | 0.5 | |
| | ΔT | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | |
| | kW | 2.89 | 2.89 | 2.89 | 2.91 | 3.22 | 3.21 | 3.21 | 3.23 | 3.23 | 3.58 | 3.58 | 3.57 | 3.59 | 3.97 | 3.97 | 3.96 | 3.98 | 4.40 | 4.40 | 4.40 | 4.42 | 4.92 | 4.91 | 4.91 | 4.93 |
| | Amps | 9.9 | 9.9 | 9.9 | 10.0 | 11.3 | 11.3 | 11.3 | 11.4 | 11.4 | 12.9 | 12.9 | 12.9 | 13.0 | 14.6 | 14.6 | 14.6 | 14.7 | 16.5 | 16.5 | 16.5 | 16.6 | 18.7 | 18.7 | 18.7 | 18.8 |
| 1800 | MBh | 50.4 | 51.1 | 52.5 | 54.7 | 50.0 | 50.7 | 52.1 | 54.3 | 48.7 | 49.4 | 50.9 | 53.0 | 46.6 | 47.3 | 48.7 | 50.9 | 44.0 | 44.6 | 46.1 | 48.3 | 41.6 | 42.3 | 43.7 | 45.9 | |
| | S/T | 0.76 | 0.69 | 0.57 | 0.4 | 0.77 | 0.70 | 0.58 | 0.4 | 1.00 | 0.72 | 0.60 | 0.5 | 1.00 | 0.74 | 0.62 | 0.5 | 1.00 | 0.76 | 0.64 | 0.5 | 1.00 | 0.81 | 0.68 | 0.6 | |
| | ΔT | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | |
| | kW | 2.91 | 2.91 | 2.90 | 2.9 | 3.23 | 3.23 | 3.22 | 3.2 | 3.2 | 3.59 | 3.59 | 3.58 | 3.6 | 3.98 | 3.98 | 3.97 | 4.0 | 4.42 | 4.42 | 4.41 | 4.4 | 4.93 | 4.93 | 4.92 | 4.9 |
| | Amps | 10.0 | 10.0 | 10.0 | 10.1 | 11.4 | 11.4 | 11.4 | 11.5 | 11.5 | 13.0 | 13.0 | 12.9 | 13.0 | 14.7 | 14.6 | 14.6 | 14.7 | 16.6 | 16.5 | 16.5 | 16.6 | 18.8 | 18.8 | 18.7 | 18.9 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA4810**/CA*TA6030*3A*+EEP - HIGH STAGE (CONT.)

| IDB | AIRFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|---------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|-------|------|-------------|------|-------|------|------|------|------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 105°F | | | | 115°F | | | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | |
| 80 | MBh | 48.7 | 49.4 | 50.8 | 53.0 | 48.3 | 49.0 | 50.4 | 52.6 | 47.0 | 47.7 | 49.1 | 51.3 | 44.9 | 45.6 | 47.0 | 49.2 | 42.3 | 42.9 | 44.4 | 46.6 | 39.9 | 40.5 | 42.0 | 44.2 |
| | S/T | 0.84 | 0.77 | 0.64 | 0.5 | 1.00 | 0.77 | 0.65 | 0.5 | 1.00 | 0.80 | 0.67 | 0.5 | 1.00 | 0.81 | 0.69 | 0.6 | 1.00 | 0.83 | 0.71 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 2.88 | 2.88 | 2.87 | 2.9 | 3.20 | 3.20 | 3.20 | 3.2 | 3.56 | 3.56 | 3.56 | 3.6 | 3.95 | 3.95 | 3.95 | 4.0 | 4.39 | 4.39 | 4.38 | 4.4 | 4.90 | 4.90 | 4.89 | 4.9 |
| | Amps | 9.9 | 9.9 | 9.8 | 9.9 | 11.3 | 11.3 | 11.2 | 11.3 | 12.8 | 12.8 | 12.8 | 12.9 | 14.5 | 14.5 | 14.5 | 14.6 | 16.4 | 16.4 | 16.4 | 16.5 | 18.7 | 18.6 | 18.6 | 18.7 |
| 1400 | MBh | 49.6 | 50.3 | 51.7 | 53.9 | 49.2 | 49.8 | 51.3 | 53.5 | 47.9 | 48.6 | 50.0 | 52.2 | 45.8 | 46.4 | 47.9 | 50.1 | 43.1 | 43.8 | 45.2 | 47.4 | 40.7 | 41.4 | 42.9 | 45.0 |
| | S/T | 0.87 | 0.80 | 0.68 | 0.5 | 1.00 | 0.81 | 0.68 | 0.6 | 1.00 | 0.83 | 0.71 | 0.6 | 1.00 | 0.85 | 0.72 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | 1.00 | 1.00 | 0.79 | 0.7 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 2.90 | 2.89 | 2.89 | 2.91 | 3.22 | 3.22 | 3.21 | 3.24 | 3.58 | 3.58 | 3.57 | 3.60 | 3.97 | 3.97 | 3.96 | 3.99 | 4.41 | 4.40 | 4.40 | 4.42 | 4.92 | 4.91 | 4.91 | 4.93 |
| | Amps | 9.9 | 9.9 | 9.9 | 10.0 | 11.3 | 11.3 | 11.3 | 11.4 | 12.9 | 12.9 | 12.9 | 13.0 | 14.6 | 14.6 | 14.6 | 14.7 | 16.5 | 16.5 | 16.5 | 16.6 | 18.7 | 18.7 | 18.7 | 18.8 |
| 1800 | MBh | 50.7 | 51.3 | 52.8 | 55.0 | 50.2 | 50.9 | 52.3 | 54.5 | 49.0 | 49.7 | 51.1 | 53.3 | 46.8 | 47.5 | 49.0 | 51.1 | 44.2 | 44.9 | 46.3 | 48.5 | 41.8 | 42.5 | 43.9 | 46.1 |
| | S/T | 1.00 | 0.81 | 0.68 | 0.6 | 1.00 | 0.81 | 0.69 | 0.6 | 1.00 | 0.84 | 0.71 | 0.6 | 1.00 | 0.85 | 0.73 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 | 1.00 | 1.00 | 0.80 | 0.7 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 2.91 | 2.91 | 2.90 | 2.9 | 3.23 | 3.23 | 3.22 | 3.2 | 3.59 | 3.59 | 3.59 | 3.6 | 3.98 | 3.98 | 3.98 | 4.0 | 4.42 | 4.42 | 4.41 | 4.4 | 4.93 | 4.93 | 4.92 | 4.9 |
| | Amps | 10.0 | 10.0 | 10.0 | 10.1 | 11.4 | 11.4 | 11.4 | 11.5 | 13.0 | 13.0 | 12.9 | 13.0 | 14.7 | 14.7 | 14.6 | 14.7 | 16.6 | 16.6 | 16.5 | 16.6 | 18.8 | 18.8 | 18.8 | 18.9 |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 85 | MBh | 49.5 | 50.2 | 51.6 | 53.8 | 49.1 | 49.8 | 51.2 | 53.4 | 47.8 | 48.5 | 50.0 | 52.1 | 45.7 | 46.4 | 47.8 | 50.0 | 43.1 | 43.8 | 45.2 | 47.4 | 40.7 | 41.4 | 42.8 | 45.0 |
| | S/T | 1.00 | 0.86 | 0.74 | 0.6 | 1.00 | 0.87 | 0.74 | 0.6 | 1.00 | 0.89 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.7 | 1.00 | 1.00 | 0.80 | 0.7 | 1.00 | 1.00 | 0.85 | 0.7 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 2.89 | 2.88 | 2.88 | 2.9 | 3.21 | 3.21 | 3.20 | 3.2 | 3.57 | 3.57 | 3.56 | 3.6 | 3.96 | 3.96 | 3.95 | 4.0 | 4.40 | 4.39 | 4.39 | 4.4 | 4.91 | 4.90 | 4.90 | 4.9 |
| | Amps | 9.9 | 9.9 | 9.9 | 10.0 | 11.3 | 11.3 | 11.3 | 11.4 | 12.9 | 12.9 | 12.8 | 12.9 | 14.6 | 14.6 | 14.5 | 14.6 | 16.5 | 16.4 | 16.4 | 16.5 | 18.7 | 18.7 | 18.6 | 18.8 |
| 1600 | MBh | 50.4 | 51.1 | 52.5 | 54.7 | 50.0 | 50.6 | 52.1 | 54.3 | 48.7 | 49.4 | 50.8 | 53.0 | 46.6 | 47.3 | 48.7 | 50.9 | 44.0 | 44.6 | 46.1 | 48.2 | 41.6 | 42.2 | 43.7 | 45.8 |
| | S/T | 1.00 | 0.89 | 0.77 | 0.6 | 1.00 | 0.90 | 0.78 | 0.6 | 1.00 | 1.00 | 0.80 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 0.88 | 0.8 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 2.90 | 2.90 | 2.89 | 2.92 | 3.23 | 3.22 | 3.22 | 3.24 | 3.59 | 3.58 | 3.58 | 3.60 | 3.98 | 3.97 | 3.97 | 3.99 | 4.41 | 4.41 | 4.40 | 4.43 | 4.92 | 4.92 | 4.92 | 4.94 |
| | Amps | 10.0 | 10.0 | 9.9 | 10.0 | 11.4 | 11.4 | 11.3 | 11.4 | 12.9 | 12.9 | 12.9 | 13.0 | 14.6 | 14.6 | 14.6 | 14.7 | 16.5 | 16.5 | 16.5 | 16.6 | 18.8 | 18.7 | 18.7 | 18.8 |
| 1800 | MBh | 51.5 | 52.2 | 53.6 | 55.8 | 51.0 | 51.7 | 53.2 | 55.3 | 49.8 | 50.5 | 51.9 | 54.1 | 47.7 | 48.3 | 49.8 | 51.9 | 45.0 | 45.7 | 47.1 | 49.3 | 42.6 | 43.3 | 44.7 | 46.9 |
| | S/T | 1.00 | 0.90 | 0.78 | 0.6 | 1.00 | 0.91 | 0.78 | 0.7 | 1.00 | 1.00 | 0.81 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 2.92 | 2.91 | 2.91 | 2.9 | 3.24 | 3.24 | 3.23 | 3.3 | 3.60 | 3.60 | 3.59 | 3.6 | 3.99 | 3.99 | 3.98 | 4.0 | 4.43 | 4.42 | 4.42 | 4.4 | 4.94 | 4.93 | 4.93 | 5.0 |
| | Amps | 10.0 | 10.0 | 10.0 | 10.1 | 11.4 | 11.4 | 11.4 | 11.5 | 13.0 | 13.0 | 13.0 | 13.1 | 14.7 | 14.7 | 14.7 | 14.8 | 16.6 | 16.6 | 16.6 | 16.7 | 18.8 | 18.8 | 18.8 | 18.9 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA4810**/CA*TA6030*3A*+EEP - LOW STAGE

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|-----------------------------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|-------|----|----|----|--|--|-------|--|--|--|--|--|
| | | 65°F | | | | | | 75°F | | | | | | 85°F | | | | | | 95°F | | | | | | 105°F | | | | | | 115°F | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | | | | | |
| 980 | MBh | 34.4 | 34.9 | 35.9 | - | 34.1 | 34.6 | 35.6 | - | 33.2 | 33.7 | 34.7 | - | 31.6 | 32.1 | 33.1 | - | 29.7 | 30.2 | 31.3 | - | 28.0 | 28.5 | 29.5 | - | | | | | | | | | | | | |
| | S/T | 0.57 | 0.49 | 0.37 | - | 0.57 | 0.50 | 0.37 | - | 0.59 | 0.52 | 0.40 | - | 0.61 | 0.54 | 0.42 | - | 1.00 | 0.56 | 0.44 | - | 1.00 | 0.61 | 0.48 | - | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | | | | | | | | | | | | |
| | kW | 1.80 | 1.80 | 1.80 | - | 2.00 | 2.00 | 2.00 | - | 2.23 | 2.23 | 2.23 | - | 2.48 | 2.48 | 2.47 | - | 2.75 | 2.75 | 2.75 | - | 3.07 | 3.07 | 3.07 | - | | | | | | | | | | | | |
| | Amps | 6.2 | 6.2 | 6.1 | - | 7.0 | 7.0 | 7.0 | - | 8.0 | 8.0 | 8.0 | - | 9.1 | 9.1 | 9.1 | - | 10.3 | 10.3 | 10.3 | - | 11.7 | 11.7 | 11.7 | - | | | | | | | | | | | | |
| 70 | MBh | 34.8 | 35.3 | 36.3 | - | 34.5 | 35.0 | 36.0 | - | 33.6 | 34.1 | 35.1 | - | 32.1 | 32.6 | 33.6 | - | 30.2 | 30.7 | 31.7 | - | 28.5 | 29.0 | 30.0 | - | | | | | | | | | | | | |
| | S/T | 0.62 | 0.55 | 0.42 | - | 0.63 | 0.56 | 0.43 | - | 0.65 | 0.58 | 0.45 | - | 0.67 | 0.60 | 0.47 | - | 1.00 | 0.62 | 0.49 | - | 1.00 | 0.67 | 0.54 | - | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | | | | | | | | | | | | |
| | kW | 1.81 | 1.81 | 1.81 | - | 2.02 | 2.01 | 2.01 | - | 2.24 | 2.24 | 2.24 | - | 2.49 | 2.49 | 2.48 | - | 2.76 | 2.76 | 2.76 | - | 3.08 | 3.08 | 3.08 | - | | | | | | | | | | | | |
| | Amps | 6.2 | 6.2 | 6.2 | - | 7.1 | 7.1 | 7.1 | - | 8.1 | 8.1 | 8.1 | - | 9.1 | 9.1 | 9.1 | - | 10.3 | 10.3 | 10.3 | - | 11.7 | 11.7 | 11.7 | - | | | | | | | | | | | | |
| 1260 | MBh | 35.4 | 35.9 | 36.9 | - | 35.1 | 35.6 | 36.6 | - | 34.2 | 34.7 | 35.7 | - | 32.6 | 33.1 | 34.1 | - | 30.7 | 31.2 | 32.2 | - | 29.0 | 29.5 | 30.5 | - | | | | | | | | | | | | |
| | S/T | 0.65 | 0.58 | 0.46 | - | 0.66 | 0.59 | 0.46 | - | 0.68 | 0.61 | 0.48 | - | 0.70 | 0.63 | 0.50 | - | 1.00 | 0.65 | 0.52 | - | 1.00 | 0.70 | 0.57 | - | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 1 | 0 | - | 1 | 0 | 0 | - | 1 | 1 | 0 | - | | | | | | | | | | | | |
| | kW | 1.82 | 1.82 | 1.82 | - | 2.02 | 2.02 | 2.02 | - | 2.25 | 2.25 | 2.25 | - | 2.50 | 2.49 | 2.49 | - | 2.77 | 2.77 | 2.77 | - | 3.09 | 3.09 | 3.09 | - | | | | | | | | | | | | |
| | Amps | 6.2 | 6.2 | 6.2 | - | 7.1 | 7.1 | 7.1 | - | 8.1 | 8.1 | 8.1 | - | 9.2 | 9.2 | 9.2 | - | 10.4 | 10.4 | 10.4 | - | 11.8 | 11.8 | 11.8 | - | | | | | | | | | | | | |

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------|----|----|----|--|--|-------|--|--|--|--|--|
| | | 65°F | | | | | | 75°F | | | | | | 85°F | | | | | | 95°F | | | | | | 105°F | | | | | | 115°F | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | | | | | |
| 1400 | MBh | 34.4 | 34.9 | 35.9 | 37.5 | 34.1 | 34.6 | 35.6 | 37.2 | 33.2 | 33.7 | 34.7 | 36.3 | 31.7 | 32.1 | 33.2 | 34.7 | 29.8 | 30.2 | 31.3 | 32.8 | 28.0 | 28.5 | 29.6 | 31.1 | | | | | | | | | | | | |
| | S/T | 0.69 | 0.61 | 0.49 | 0.4 | 0.69 | 0.62 | 0.49 | 0.4 | 0.72 | 0.64 | 0.52 | 0.4 | 1.00 | 0.66 | 0.54 | 0.4 | 1.00 | 0.68 | 0.56 | 0.4 | 1.00 | 0.73 | 0.60 | 0.5 | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 1 | | | | | | | | | | | | |
| | kW | 1.80 | 1.80 | 1.80 | 1.8 | 2.00 | 2.00 | 2.00 | 2.0 | 2.23 | 2.23 | 2.22 | 2.2 | 2.48 | 2.47 | 2.47 | 2.5 | 2.75 | 2.75 | 2.74 | 2.8 | 3.07 | 3.07 | 3.07 | 3.1 | | | | | | | | | | | | |
| | Amps | 6.2 | 6.2 | 6.1 | 6.2 | 7.0 | 7.0 | 7.0 | 7.1 | 8.0 | 8.0 | 8.0 | 8.1 | 9.1 | 9.1 | 9.1 | 9.1 | 10.3 | 10.3 | 10.3 | 10.3 | 11.7 | 11.7 | 11.7 | 11.7 | | | | | | | | | | | | |
| 75 | MBh | 34.9 | 35.3 | 36.4 | 37.9 | 34.5 | 35.0 | 36.1 | 37.6 | 33.6 | 34.1 | 35.2 | 36.7 | 32.1 | 32.6 | 33.6 | 35.2 | 30.2 | 30.7 | 31.7 | 33.3 | 28.5 | 29.0 | 30.0 | 31.6 | | | | | | | | | | | | |
| | S/T | 0.74 | 0.67 | 0.54 | 0.4 | 0.75 | 0.68 | 0.55 | 0.4 | 1.00 | 0.70 | 0.57 | 0.4 | 1.00 | 0.72 | 0.59 | 0.5 | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.79 | 0.66 | 0.5 | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | | | | | | | | | | | | |
| | kW | 1.81 | 1.81 | 1.81 | 1.82 | 2.01 | 2.01 | 2.01 | 2.02 | 2.24 | 2.24 | 2.24 | 2.25 | 2.49 | 2.48 | 2.48 | 2.50 | 2.76 | 2.76 | 2.76 | 2.77 | 3.08 | 3.08 | 3.08 | 3.09 | | | | | | | | | | | | |
| | Amps | 6.2 | 6.2 | 6.2 | 6.2 | 7.1 | 7.1 | 7.1 | 7.1 | 8.1 | 8.1 | 8.1 | 8.1 | 9.1 | 9.1 | 9.1 | 9.2 | 10.3 | 10.3 | 10.3 | 10.4 | 11.7 | 11.7 | 11.7 | 11.8 | | | | | | | | | | | | |
| 1800 | MBh | 35.4 | 35.9 | 36.9 | 38.5 | 35.1 | 35.6 | 36.6 | 38.2 | 34.2 | 34.7 | 35.7 | 37.3 | 32.6 | 33.1 | 34.2 | 35.7 | 30.8 | 31.2 | 32.3 | 33.8 | 29.0 | 29.5 | 30.5 | 32.1 | | | | | | | | | | | | |
| | S/T | 0.77 | 0.70 | 0.58 | 0.4 | 0.78 | 0.71 | 0.58 | 0.4 | 1.00 | 0.73 | 0.61 | 0.5 | 1.00 | 0.75 | 0.62 | 0.5 | 1.00 | 0.77 | 0.64 | 0.5 | 1.00 | 1.00 | 0.69 | 0.6 | | | | | | | | | | | | |
| | ΔT | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | 1 | 1 | 1 | 0 | | | | | | | | | | | | |
| | kW | 1.82 | 1.82 | 1.81 | 1.8 | 2.02 | 2.02 | 2.02 | 2.0 | 2.25 | 2.25 | 2.24 | 2.3 | 2.49 | 2.49 | 2.49 | 2.5 | 2.77 | 2.77 | 2.76 | 2.8 | 3.09 | 3.09 | 3.09 | 3.1 | | | | | | | | | | | | |
| | Amps | 6.2 | 6.2 | 6.2 | 6.3 | 7.1 | 7.1 | 7.1 | 7.2 | 8.1 | 8.1 | 8.1 | 8.2 | 9.2 | 9.2 | 9.2 | 9.2 | 10.4 | 10.4 | 10.3 | 10.4 | 11.8 | 11.8 | 11.8 | 11.8 | | | | | | | | | | | | |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ALXT7CA4810**/CA*TA6030*3A*+EEP - LOW STAGE (CONT.)

| IDB | AIRFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|---------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------------|------|-------|------|------|------|-------|------|------|------|------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | |
| 80 | MBh | 34.6 | 35.1 | 36.1 | 37.7 | 34.3 | 34.8 | 35.8 | 37.4 | 33.4 | 33.9 | 34.9 | 36.5 | 31.8 | 32.3 | 33.3 | 34.9 | 29.9 | 30.4 | 31.5 | 33.0 | 29.9 | 30.4 | 31.5 | 33.0 | 28.2 | 28.7 | 29.7 | 31.3 |
| | S/T | 0.80 | 0.73 | 0.61 | 0.5 | 1.00 | 0.74 | 0.61 | 0.5 | 1.00 | 0.76 | 0.63 | 0.5 | 1.00 | 0.78 | 0.65 | 0.5 | 1.00 | 1.00 | 0.67 | 0.5 | 1.00 | 1.00 | 0.67 | 0.5 | 1.00 | 1.00 | 0.72 | 0.6 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 1.80 | 1.80 | 1.80 | 1.8 | 2.00 | 2.00 | 2.00 | 2.0 | 2.23 | 2.23 | 2.23 | 2.2 | 2.48 | 2.47 | 2.47 | 2.5 | 2.75 | 2.75 | 2.75 | 2.8 | 2.75 | 2.75 | 2.75 | 2.8 | 3.07 | 3.07 | 3.07 | 3.1 |
| | Amps | 6.2 | 6.2 | 6.1 | 6.2 | 7.0 | 7.0 | 7.0 | 7.1 | 8.0 | 8.0 | 8.0 | 8.1 | 9.1 | 9.1 | 9.1 | 9.1 | 10.3 | 10.3 | 10.3 | 10.3 | 10.3 | 10.3 | 10.3 | 10.3 | 11.7 | 11.7 | 11.7 | 11.7 |
| 80 | MBh | 35.0 | 35.5 | 36.5 | 38.1 | 34.7 | 35.2 | 36.2 | 37.8 | 33.8 | 34.3 | 35.3 | 36.9 | 32.3 | 32.8 | 33.8 | 35.4 | 30.4 | 30.9 | 31.9 | 33.5 | 30.4 | 30.9 | 31.9 | 33.5 | 28.7 | 29.2 | 30.2 | 31.8 |
| | S/T | 0.86 | 0.79 | 0.66 | 0.5 | 1.00 | 0.79 | 0.67 | 0.5 | 1.00 | 0.82 | 0.69 | 0.6 | 1.00 | 0.84 | 0.71 | 0.6 | 1.00 | 1.00 | 0.73 | 0.6 | 1.00 | 1.00 | 0.73 | 0.6 | 1.00 | 1.00 | 0.78 | 0.6 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 1.81 | 1.81 | 1.81 | 1.82 | 2.01 | 2.01 | 2.01 | 2.03 | 2.24 | 2.24 | 2.24 | 2.25 | 2.49 | 2.49 | 2.48 | 2.50 | 2.76 | 2.76 | 2.76 | 2.77 | 2.76 | 2.76 | 2.76 | 2.77 | 3.08 | 3.08 | 3.08 | 3.09 |
| | Amps | 6.2 | 6.2 | 6.2 | 6.3 | 7.1 | 7.1 | 7.1 | 7.1 | 8.1 | 8.1 | 8.1 | 8.1 | 9.1 | 9.1 | 9.1 | 9.2 | 10.3 | 10.3 | 10.3 | 10.4 | 10.3 | 10.3 | 10.3 | 10.4 | 11.7 | 11.7 | 11.7 | 11.8 |
| 1260 | MBh | 35.6 | 36.1 | 37.1 | 38.7 | 35.3 | 35.8 | 36.8 | 38.3 | 34.4 | 34.9 | 35.9 | 37.4 | 32.8 | 33.3 | 34.3 | 35.9 | 30.9 | 31.4 | 32.4 | 34.0 | 30.9 | 31.4 | 32.4 | 34.0 | 29.2 | 29.7 | 30.7 | 32.3 |
| | S/T | 1.00 | 0.82 | 0.69 | 0.6 | 1.00 | 0.83 | 0.70 | 0.6 | 1.00 | 0.85 | 0.72 | 0.6 | 1.00 | 0.87 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.81 | 0.7 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 1.82 | 1.82 | 1.82 | 1.8 | 2.02 | 2.02 | 2.02 | 2.0 | 2.25 | 2.25 | 2.25 | 2.3 | 2.50 | 2.49 | 2.49 | 2.5 | 2.77 | 2.77 | 2.76 | 2.8 | 2.77 | 2.77 | 2.76 | 2.8 | 3.09 | 3.09 | 3.09 | 3.1 |
| | Amps | 6.2 | 6.2 | 6.2 | 6.3 | 7.1 | 7.1 | 7.1 | 7.2 | 8.1 | 8.1 | 8.1 | 8.2 | 9.2 | 9.2 | 9.2 | 9.2 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 11.8 | 11.8 | 11.8 | 11.8 |

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 85 | MBh | 35.2 | 35.6 | 36.7 | 38.2 | 34.9 | 35.3 | 36.4 | 37.9 | 34.0 | 34.4 | 35.5 | 37.0 | 32.4 | 32.9 | 33.9 | 35.5 | 30.5 | 31.0 | 32.0 | 33.6 | 30.5 | 31.0 | 32.0 | 33.6 | 28.8 | 29.3 | 30.3 | 31.9 |
| | S/T | 1.00 | 0.83 | 0.70 | 0.6 | 1.00 | 0.83 | 0.71 | 0.6 | 1.00 | 1.00 | 0.73 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 | 1.00 | 1.00 | 0.77 | 0.6 | 1.00 | 1.00 | 0.77 | 0.6 | 1.00 | 1.00 | 0.82 | 0.7 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 1.81 | 1.80 | 1.80 | 1.8 | 2.01 | 2.01 | 2.00 | 2.0 | 2.23 | 2.23 | 2.23 | 2.2 | 2.48 | 2.48 | 2.48 | 2.5 | 2.75 | 2.75 | 2.75 | 2.8 | 2.75 | 2.75 | 2.75 | 2.8 | 3.08 | 3.07 | 3.07 | 3.1 |
| | Amps | 6.2 | 6.2 | 6.2 | 6.2 | 7.1 | 7.1 | 7.0 | 7.1 | 8.0 | 8.0 | 8.0 | 8.1 | 9.1 | 9.1 | 9.1 | 9.2 | 10.3 | 10.3 | 10.3 | 10.4 | 10.3 | 10.3 | 10.3 | 10.4 | 11.7 | 11.7 | 11.7 | 11.8 |
| 85 | MBh | 35.6 | 36.1 | 37.1 | 38.7 | 35.3 | 35.8 | 36.8 | 38.4 | 34.4 | 34.9 | 35.9 | 37.5 | 32.9 | 33.3 | 34.4 | 35.9 | 31.0 | 31.5 | 32.5 | 34.1 | 31.0 | 31.5 | 32.5 | 34.1 | 29.2 | 29.7 | 30.8 | 32.3 |
| | S/T | 1.00 | 0.88 | 0.76 | 0.6 | 1.00 | 0.89 | 0.76 | 0.6 | 1.00 | 1.00 | 0.79 | 0.7 | 1.00 | 1.00 | 0.80 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 1.82 | 1.81 | 1.81 | 1.83 | 2.02 | 2.02 | 2.01 | 2.03 | 2.25 | 2.24 | 2.24 | 2.26 | 2.49 | 2.49 | 2.49 | 2.50 | 2.77 | 2.76 | 2.76 | 2.78 | 2.77 | 2.76 | 2.76 | 2.78 | 3.09 | 3.09 | 3.08 | 3.10 |
| | Amps | 6.2 | 6.2 | 6.2 | 6.3 | 7.1 | 7.1 | 7.1 | 7.2 | 8.1 | 8.1 | 8.1 | 8.1 | 9.2 | 9.2 | 9.1 | 9.2 | 10.4 | 10.3 | 10.3 | 10.4 | 10.4 | 10.3 | 10.3 | 10.4 | 11.8 | 11.7 | 11.7 | 11.8 |
| 1260 | MBh | 36.2 | 36.6 | 37.7 | 39.2 | 35.8 | 36.3 | 37.4 | 38.9 | 34.9 | 35.4 | 36.5 | 38.0 | 33.4 | 33.9 | 34.9 | 36.5 | 31.5 | 32.0 | 33.0 | 34.6 | 31.5 | 32.0 | 33.0 | 34.6 | 29.8 | 30.3 | 31.3 | 32.9 |
| | S/T | 1.00 | 0.91 | 0.79 | 0.7 | 1.00 | 0.92 | 0.79 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 | 1.00 | 1.00 | 0.84 | 0.7 | 1.00 | 1.00 | 0.86 | 0.7 | 1.00 | 1.00 | 0.86 | 0.7 | 1.00 | 1.00 | 1.00 | 0.8 |
| | ΔT | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | kW | 1.82 | 1.82 | 1.82 | 1.8 | 2.03 | 2.03 | 2.02 | 2.0 | 2.25 | 2.25 | 2.25 | 2.3 | 2.50 | 2.50 | 2.49 | 2.5 | 2.77 | 2.77 | 2.77 | 2.8 | 2.77 | 2.77 | 2.77 | 2.8 | 3.10 | 3.09 | 3.09 | 3.1 |
| | Amps | 6.3 | 6.3 | 6.2 | 6.3 | 7.1 | 7.1 | 7.1 | 7.2 | 8.1 | 8.1 | 8.1 | 8.2 | 9.2 | 9.2 | 9.2 | 9.2 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 10.4 | 11.8 | 11.8 | 11.8 | 11.8 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA – ALXT7CA6010**/CA*TA6030*3A*+EEP - HIGH STAGE

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|-----------------------------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|------|------|------|----|-------|----|----|----|--|--|-------|--|--|--|--|--|
| | | 65°F | | | | | | 75°F | | | | | | 85°F | | | | | | 95°F | | | | | | 105°F | | | | | | 115°F | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | | | | | |
| 70 | MBh | 58.8 | 59.6 | 61.3 | - | 58.2 | 59.1 | 60.8 | - | 56.7 | 57.5 | 59.3 | - | 54.1 | 54.9 | 56.7 | - | 50.9 | 51.7 | 53.5 | - | 48.0 | 48.8 | 50.6 | - | | | | | | | | | | | | |
| | S/T | 0.59 | 0.52 | 0.40 | - | 0.59 | 0.53 | 0.41 | - | 0.62 | 0.55 | 0.43 | - | 0.63 | 0.57 | 0.45 | - | 0.65 | 0.58 | 0.47 | - | 1.00 | 0.63 | 0.51 | - | | | | | | | | | | | | |
| | ΔT | 22 | 20 | 16 | - | 22 | 20 | 16 | - | 23 | 20 | 16 | - | 22 | 20 | 16 | - | 22 | 20 | 16 | - | 23 | 21 | 17 | - | | | | | | | | | | | | |
| | kW | 3.52 | 3.52 | 3.51 | - | 3.94 | 3.94 | 3.93 | - | 4.41 | 4.41 | 4.40 | - | 4.92 | 4.92 | 4.91 | - | 5.49 | 5.48 | 5.48 | - | 6.15 | 6.15 | 6.14 | - | | | | | | | | | | | | |
| | Amps | 12.5 | 12.4 | 12.4 | - | 14.3 | 14.3 | 14.2 | - | 16.3 | 16.3 | 16.3 | - | 18.5 | 18.5 | 18.5 | - | 21.0 | 21.0 | 20.9 | - | 23.9 | 23.9 | 23.8 | - | | | | | | | | | | | | |
| 2000 | MBh | 61.8 | 62.6 | 64.3 | - | 61.2 | 62.1 | 63.8 | - | 59.7 | 60.5 | 62.3 | - | 57.1 | 57.9 | 59.7 | - | 53.9 | 54.8 | 56.5 | - | 51.0 | 51.9 | 53.6 | - | | | | | | | | | | | | |
| | S/T | 0.62 | 0.56 | 0.44 | - | 0.63 | 0.56 | 0.44 | - | 0.65 | 0.58 | 0.46 | - | 0.67 | 0.60 | 0.48 | - | 1.00 | 0.62 | 0.50 | - | 1.00 | 0.67 | 0.55 | - | | | | | | | | | | | | |
| | ΔT | 20 | 17 | 13 | - | 19 | 17 | 13 | - | 20 | 18 | 14 | - | 19 | 17 | 13 | - | 19 | 17 | 13 | - | 21 | 18 | 14 | - | | | | | | | | | | | | |
| | kW | 3.57 | 3.57 | 3.56 | - | 3.99 | 3.99 | 3.98 | - | 4.46 | 4.46 | 4.45 | - | 4.97 | 4.96 | 4.96 | - | 5.53 | 5.53 | 5.52 | - | 6.20 | 6.19 | 6.19 | - | | | | | | | | | | | | |
| | Amps | 12.7 | 12.6 | 12.6 | - | 14.5 | 14.5 | 14.4 | - | 16.5 | 16.5 | 16.5 | - | 18.7 | 18.7 | 18.7 | - | 21.2 | 21.2 | 21.1 | - | 24.1 | 24.1 | 24.0 | - | | | | | | | | | | | | |
| 2250 | MBh | 63.8 | 64.7 | 66.4 | - | 63.3 | 64.1 | 65.9 | - | 61.8 | 62.6 | 64.4 | - | 59.2 | 60.0 | 61.7 | - | 56.0 | 56.8 | 58.6 | - | 53.1 | 53.9 | 55.7 | - | | | | | | | | | | | | |
| | S/T | 0.59 | 0.52 | 0.40 | - | 0.59 | 0.53 | 0.41 | - | 0.62 | 0.55 | 0.43 | - | 1.00 | 0.57 | 0.45 | - | 1.00 | 0.59 | 0.47 | - | 1.00 | 0.63 | 0.51 | - | | | | | | | | | | | | |
| | ΔT | 18 | 16 | 12 | - | 18 | 16 | 12 | - | 19 | 16 | 12 | - | 18 | 16 | 12 | - | 18 | 16 | 12 | - | 19 | 17 | 13 | - | | | | | | | | | | | | |
| | kW | 3.59 | 3.59 | 3.58 | - | 4.01 | 4.01 | 4.00 | - | 4.48 | 4.48 | 4.47 | - | 4.99 | 4.98 | 4.98 | - | 5.55 | 5.55 | 5.54 | - | 6.22 | 6.21 | 6.21 | - | | | | | | | | | | | | |
| | Amps | 12.7 | 12.7 | 12.7 | - | 14.6 | 14.5 | 14.5 | - | 16.6 | 16.6 | 16.6 | - | 18.8 | 18.8 | 18.8 | - | 21.3 | 21.3 | 21.2 | - | 24.2 | 24.1 | 24.1 | - | | | | | | | | | | | | |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 75 | MBh | 58.8 | 59.6 | 61.3 | 64.0 | 58.3 | 59.1 | 60.8 | 63.5 | 56.8 | 57.6 | 59.3 | 62.0 | 54.1 | 55.0 | 56.7 | 59.3 | 51.0 | 51.8 | 53.5 | 56.2 | 48.1 | 48.9 | 50.6 | 53.3 |
| | S/T | 0.70 | 0.63 | 0.51 | 0.4 | 0.71 | 0.64 | 0.52 | 0.4 | 0.73 | 0.66 | 0.54 | 0.4 | 1.00 | 0.68 | 0.56 | 0.4 | 1.00 | 0.70 | 0.58 | 0.5 | 1.00 | 0.74 | 0.62 | 0.5 |
| | ΔT | 27 | 25 | 21 | 17 | 27 | 25 | 21 | 17 | 27 | 25 | 21 | 17 | 27 | 25 | 21 | 17 | 27 | 25 | 21 | 16 | 28 | 26 | 22 | 18 |
| | kW | 3.52 | 3.52 | 3.51 | 3.5 | 3.94 | 3.94 | 3.93 | 4.0 | 4.41 | 4.41 | 4.40 | 4.4 | 4.92 | 4.91 | 4.91 | 4.9 | 5.48 | 5.48 | 5.47 | 5.5 | 6.15 | 6.15 | 6.14 | 6.2 |
| | Amps | 12.4 | 12.4 | 12.4 | 12.5 | 14.3 | 14.3 | 14.2 | 14.4 | 16.3 | 16.3 | 16.3 | 16.4 | 18.5 | 18.5 | 18.5 | 18.6 | 21.0 | 21.0 | 20.9 | 21.1 | 23.9 | 23.8 | 23.8 | 24.0 |
| 2000 | MBh | 61.8 | 62.6 | 64.3 | 67.0 | 61.3 | 62.1 | 63.8 | 66.5 | 59.8 | 60.6 | 62.3 | 65.0 | 57.2 | 58.0 | 59.7 | 62.4 | 54.0 | 54.8 | 56.5 | 59.2 | 51.1 | 51.9 | 53.6 | 56.3 |
| | S/T | 0.74 | 0.67 | 0.55 | 0.4 | 0.74 | 0.67 | 0.56 | 0.4 | 1.00 | 0.70 | 0.58 | 0.5 | 1.00 | 0.71 | 0.59 | 0.5 | 1.00 | 0.73 | 0.61 | 0.5 | 1.00 | 0.78 | 0.66 | 0.5 |
| | ΔT | 24 | 22 | 18 | 14 | 24 | 22 | 18 | 14 | 25 | 22 | 18 | 14 | 24 | 22 | 18 | 14 | 24 | 22 | 18 | 13 | 25 | 23 | 19 | 15 |
| | kW | 3.57 | 3.56 | 3.56 | 3.59 | 3.99 | 3.98 | 3.98 | 4.01 | 4.46 | 4.45 | 4.45 | 4.48 | 4.96 | 4.96 | 4.95 | 4.99 | 5.53 | 5.53 | 5.52 | 5.55 | 6.20 | 6.19 | 6.19 | 6.22 |
| | Amps | 12.6 | 12.6 | 12.6 | 12.7 | 14.5 | 14.5 | 14.4 | 14.6 | 16.5 | 16.5 | 16.5 | 16.6 | 18.7 | 18.7 | 18.7 | 18.8 | 21.2 | 21.2 | 21.1 | 21.3 | 24.1 | 24.0 | 24.0 | 24.2 |
| 2250 | MBh | 63.9 | 64.7 | 66.4 | 69.1 | 63.3 | 64.2 | 65.9 | 68.5 | 61.8 | 62.7 | 64.4 | 67.0 | 59.2 | 60.0 | 61.8 | 64.4 | 56.0 | 56.9 | 58.6 | 61.2 | 53.1 | 54.0 | 55.7 | 58.3 |
| | S/T | 0.70 | 0.64 | 0.52 | 0.4 | 0.71 | 0.64 | 0.52 | 0.4 | 1.00 | 0.66 | 0.54 | 0.4 | 1.00 | 0.68 | 0.56 | 0.4 | 1.00 | 0.70 | 0.58 | 0.5 | 1.00 | 1.00 | 0.63 | 0.5 |
| | ΔT | 23 | 21 | 17 | 13 | 23 | 21 | 17 | 13 | 23 | 21 | 17 | 13 | 23 | 21 | 17 | 13 | 23 | 21 | 17 | 12 | 24 | 22 | 18 | 14 |
| | kW | 3.59 | 3.58 | 3.58 | 3.6 | 4.01 | 4.00 | 4.00 | 4.0 | 4.48 | 4.47 | 4.47 | 4.5 | 4.98 | 4.98 | 4.97 | 5.0 | 5.55 | 5.55 | 5.54 | 5.6 | 6.21 | 6.21 | 6.20 | 6.2 |
| | Amps | 12.7 | 12.7 | 12.7 | 12.8 | 14.5 | 14.5 | 14.5 | 14.6 | 16.6 | 16.6 | 16.5 | 16.7 | 18.8 | 18.8 | 18.7 | 18.9 | 21.3 | 21.2 | 21.2 | 21.4 | 24.1 | 24.1 | 24.1 | 24.2 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA – ALXT7CA6010**/CA*TA6030*3A*+EEP - HIGH STAGEE (CONT.)

| IDB | AIRFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|-----------|---------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|-------|------|------|------|-------|------|------|------|------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 105°F | | | | 115°F | | | | | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | | | | |
| 80 | MBh | 59.1 | 59.9 | 61.6 | 64.3 | 58.6 | 59.4 | 61.1 | 63.8 | 57.1 | 57.9 | 59.6 | 62.3 | 54.4 | 55.3 | 57.0 | 59.6 | 51.3 | 52.1 | 53.8 | 56.5 | 48.4 | 49.2 | 50.9 | 53.6 |
| | S/T | 0.81 | 0.75 | 0.63 | 0.5 | 1.00 | 0.75 | 0.63 | 0.5 | 1.00 | 0.77 | 0.65 | 0.5 | 1.00 | 0.79 | 0.67 | 0.5 | 1.00 | 0.81 | 0.69 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 |
| | ΔT | 32 | 30 | 26 | 21 | 32 | 30 | 26 | 21 | 32 | 30 | 26 | 22 | 32 | 30 | 26 | 21 | 32 | 29 | 25 | 21 | 33 | 31 | 27 | 22 |
| | kW | 3.52 | 3.52 | 3.51 | 3.5 | 3.94 | 3.94 | 3.93 | 4.0 | 4.41 | 4.41 | 4.40 | 4.4 | 4.92 | 4.92 | 4.91 | 4.9 | 5.49 | 5.48 | 5.48 | 5.5 | 6.15 | 6.15 | 6.14 | 6.2 |
| | Amps | 12.4 | 12.4 | 12.4 | 12.5 | 14.3 | 14.3 | 14.2 | 14.4 | 16.3 | 16.3 | 16.3 | 16.4 | 18.5 | 18.5 | 18.5 | 18.6 | 21.0 | 21.0 | 20.9 | 21.1 | 23.9 | 23.9 | 23.8 | 24.0 |
| MBh | 62.1 | 62.9 | 64.6 | 67.3 | 61.6 | 62.4 | 64.1 | 66.8 | 60.1 | 60.9 | 62.6 | 65.3 | 57.5 | 58.3 | 60.0 | 62.7 | 54.3 | 55.1 | 56.8 | 59.5 | 51.4 | 52.2 | 53.9 | 56.6 | |
| S/T | 0.85 | 0.78 | 0.66 | 0.5 | 1.00 | 0.79 | 0.67 | 0.5 | 1.00 | 0.81 | 0.69 | 0.6 | 1.00 | 0.82 | 0.71 | 0.6 | 1.00 | 1.00 | 0.72 | 0.6 | 1.00 | 1.00 | 0.77 | 0.6 | |
| ΔT | 29 | 27 | 23 | 19 | 29 | 27 | 23 | 19 | 29 | 27 | 23 | 19 | 29 | 27 | 23 | 19 | 29 | 27 | 23 | 18 | 30 | 28 | 24 | 20 | |
| kW | 3.57 | 3.57 | 3.56 | 3.59 | 3.99 | 3.99 | 3.98 | 4.01 | 4.46 | 4.46 | 4.45 | 4.48 | 4.97 | 4.96 | 4.96 | 4.99 | 5.53 | 5.53 | 5.52 | 5.55 | 6.20 | 6.19 | 6.19 | 6.22 | |
| Amps | 12.6 | 12.6 | 12.6 | 12.7 | 14.5 | 14.5 | 14.4 | 14.6 | 16.5 | 16.5 | 16.5 | 16.6 | 18.7 | 18.7 | 18.7 | 18.8 | 21.2 | 21.2 | 21.1 | 21.3 | 24.1 | 24.1 | 24.0 | 24.2 | |
| MBh | 64.2 | 65.0 | 66.7 | 69.4 | 63.6 | 64.5 | 66.2 | 68.8 | 62.1 | 63.0 | 64.7 | 67.3 | 59.5 | 60.3 | 62.1 | 64.7 | 56.3 | 57.2 | 58.9 | 61.5 | 53.4 | 54.3 | 56.0 | 58.6 | |
| S/T | 1.00 | 0.75 | 0.63 | 0.5 | 1.00 | 0.75 | 0.63 | 0.5 | 1.00 | 0.77 | 0.65 | 0.5 | 1.00 | 0.79 | 0.67 | 0.5 | 1.00 | 1.00 | 0.69 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | |
| ΔT | 28 | 26 | 22 | 17 | 28 | 26 | 22 | 17 | 28 | 26 | 22 | 18 | 28 | 26 | 22 | 17 | 28 | 25 | 21 | 17 | 29 | 27 | 23 | 18 | |
| kW | 3.59 | 3.59 | 3.58 | 3.6 | 4.01 | 4.01 | 4.00 | 4.0 | 4.48 | 4.47 | 4.47 | 4.5 | 4.99 | 4.98 | 4.97 | 5.0 | 5.55 | 5.55 | 5.54 | 5.6 | 6.22 | 6.21 | 6.21 | 6.2 | |
| Amps | 12.7 | 12.7 | 12.7 | 12.8 | 14.6 | 14.5 | 14.5 | 14.7 | 16.6 | 16.6 | 16.6 | 16.7 | 18.8 | 18.8 | 18.8 | 18.9 | 21.3 | 21.3 | 21.2 | 21.4 | 24.2 | 24.1 | 24.1 | 24.3 | |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 85 | MBh | 60.1 | 60.9 | 62.6 | 65.3 | 59.5 | 60.4 | 62.1 | 64.7 | 58.0 | 58.8 | 60.6 | 63.2 | 55.4 | 56.2 | 58.0 | 60.6 | 52.2 | 53.1 | 54.8 | 57.4 | 49.3 | 50.2 | 51.9 | 54.5 |
| | S/T | 1.00 | 0.83 | 0.71 | 0.6 | 1.00 | 0.84 | 0.72 | 0.6 | 1.00 | 0.86 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.7 | 1.00 | 1.00 | 0.82 | 0.7 |
| | ΔT | 36 | 34 | 30 | 26 | 36 | 34 | 30 | 26 | 37 | 34 | 30 | 26 | 36 | 34 | 30 | 26 | 36 | 34 | 30 | 25 | 37 | 35 | 31 | 27 |
| | kW | 3.53 | 3.53 | 3.52 | 3.6 | 3.95 | 3.95 | 3.94 | 4.0 | 4.42 | 4.42 | 4.41 | 4.4 | 4.93 | 4.92 | 4.92 | 4.9 | 5.49 | 5.49 | 5.48 | 5.5 | 6.16 | 6.16 | 6.15 | 6.2 |
| | Amps | 12.5 | 12.5 | 12.4 | 12.6 | 14.3 | 14.3 | 14.3 | 14.4 | 16.3 | 16.3 | 16.3 | 16.4 | 18.6 | 18.5 | 18.5 | 18.6 | 21.0 | 21.0 | 21.0 | 21.1 | 23.9 | 23.9 | 23.9 | 24.0 |
| MBh | 63.1 | 63.9 | 65.6 | 68.3 | 62.6 | 63.4 | 65.1 | 67.8 | 61.0 | 61.9 | 63.6 | 66.2 | 58.4 | 59.3 | 61.0 | 63.6 | 55.3 | 56.1 | 57.8 | 60.4 | 52.3 | 53.2 | 54.9 | 57.5 | |
| S/T | 1.00 | 0.87 | 0.75 | 0.6 | 1.00 | 0.87 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.7 | 1.00 | 1.00 | 0.79 | 0.7 | 1.00 | 1.00 | 0.81 | 0.7 | 1.00 | 1.00 | 0.86 | 0.7 | |
| ΔT | 33 | 31 | 27 | 23 | 33 | 31 | 27 | 23 | 34 | 32 | 27 | 23 | 33 | 31 | 27 | 23 | 33 | 31 | 27 | 23 | 34 | 32 | 28 | 24 | |
| kW | 3.58 | 3.58 | 3.57 | 3.60 | 4.00 | 3.99 | 3.99 | 4.02 | 4.47 | 4.46 | 4.46 | 4.49 | 4.97 | 4.97 | 4.96 | 5.00 | 5.54 | 5.54 | 5.53 | 5.56 | 6.21 | 6.20 | 6.20 | 6.23 | |
| Amps | 12.7 | 12.7 | 12.6 | 12.8 | 14.5 | 14.5 | 14.5 | 14.6 | 16.5 | 16.5 | 16.5 | 16.6 | 18.8 | 18.7 | 18.7 | 18.8 | 21.2 | 21.2 | 21.2 | 21.3 | 24.1 | 24.1 | 24.1 | 24.2 | |
| MBh | 65.1 | 66.0 | 67.7 | 70.3 | 64.6 | 65.4 | 67.2 | 69.8 | 63.1 | 63.9 | 65.7 | 68.3 | 60.5 | 61.3 | 63.1 | 65.7 | 57.3 | 58.1 | 59.9 | 62.5 | 54.4 | 55.2 | 57.0 | 59.6 | |
| S/T | 1.00 | 0.84 | 0.72 | 0.6 | 1.00 | 1.00 | 0.72 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.7 | 1.00 | 1.00 | 1.00 | 0.7 | |
| ΔT | 32 | 30 | 26 | 22 | 32 | 30 | 26 | 22 | 33 | 30 | 26 | 22 | 32 | 30 | 26 | 22 | 32 | 30 | 26 | 21 | 33 | 31 | 27 | 23 | |
| kW | 3.60 | 3.59 | 3.59 | 3.6 | 4.02 | 4.01 | 4.01 | 4.0 | 4.49 | 4.48 | 4.48 | 4.5 | 4.99 | 4.99 | 4.98 | 5.0 | 5.56 | 5.56 | 5.55 | 5.6 | 6.23 | 6.22 | 6.21 | 6.2 | |
| Amps | 12.8 | 12.8 | 12.7 | 12.9 | 14.6 | 14.6 | 14.5 | 14.7 | 16.6 | 16.6 | 16.6 | 16.7 | 18.8 | 18.8 | 18.8 | 18.9 | 21.3 | 21.3 | 21.3 | 21.4 | 24.2 | 24.2 | 24.1 | 24.3 | |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA – ALXT7CA6010**/CA*TA6030*3A*+EEP - LOW STAGE

| IDB | AIRFLOW | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|---------|-----------------------------|-------|-------|----|-------|-------|-------|----|-------|-------|-------|----|-------|-------|-------|----|-------|-------|-------|----|-------|-------|-------|----|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| 70 | MBh | 41.2 | 41.8 | 43.0 | - | 40.8 | 41.4 | 42.7 | - | 39.7 | 40.3 | 41.6 | - | 37.9 | 38.5 | 39.7 | - | 35.6 | 36.2 | 37.4 | - | 33.5 | 34.1 | 35.3 | - |
| | S/T | 0.46 | 0.39 | 0.27 | - | 0.46 | 0.40 | 0.27 | - | 0.49 | 0.42 | 0.30 | - | 0.50 | 0.44 | 0.31 | - | 0.52 | 0.46 | 0.33 | - | 1.00 | 0.50 | 0.38 | - |
| | ΔT | 24.56 | 22.45 | 18.50 | - | 24.50 | 22.39 | 18.44 | - | 24.80 | 22.68 | 18.74 | - | 24.48 | 22.37 | 18.42 | - | 24.20 | 22.08 | 18.14 | - | 25.52 | 23.41 | 19.46 | - |
| | kW | 2.18 | 2.18 | 2.18 | - | 2.45 | 2.45 | 2.44 | - | 2.74 | 2.74 | 2.74 | - | 3.06 | 3.06 | 3.06 | - | 3.42 | 3.42 | 3.41 | - | 3.84 | 3.84 | 3.83 | - |
| | Amps | 7.7 | 7.7 | 7.7 | - | 8.8 | 8.8 | 8.8 | - | 10.1 | 10.1 | 10.1 | - | 11.5 | 11.5 | 11.5 | - | 13.1 | 13.1 | 13.0 | - | 14.9 | 14.9 | 14.8 | - |
| 1040 | MBh | 42.2 | 42.8 | 44.1 | - | 41.9 | 42.5 | 43.7 | - | 40.8 | 41.4 | 42.6 | - | 38.9 | 39.5 | 40.7 | - | 36.6 | 37.2 | 38.5 | - | 34.5 | 35.1 | 36.4 | - |
| | S/T | 0.60 | 0.53 | 0.41 | - | 0.61 | 0.54 | 0.42 | - | 0.63 | 0.56 | 0.44 | - | 0.65 | 0.58 | 0.46 | - | 0.67 | 0.60 | 0.48 | - | 1.00 | 0.65 | 0.52 | - |
| | ΔT | 21.56 | 19.45 | 15.51 | - | 21.51 | 19.39 | 15.45 | - | 21.80 | 19.69 | 15.75 | - | 21.48 | 19.37 | 15.43 | - | 21.20 | 19.09 | 15.15 | - | 22.52 | 20.41 | 16.47 | - |
| | kW | 2.22 | 2.22 | 2.21 | - | 2.48 | 2.48 | 2.47 | - | 2.78 | 2.77 | 2.77 | - | 3.10 | 3.09 | 3.09 | - | 3.45 | 3.45 | 3.44 | - | 3.87 | 3.87 | 3.86 | - |
| | Amps | 7.8 | 7.8 | 7.8 | - | 9.0 | 9.0 | 9.0 | - | 10.3 | 10.3 | 10.2 | - | 11.6 | 11.6 | 11.6 | - | 13.2 | 13.2 | 13.2 | - | 15.0 | 15.0 | 15.0 | - |
| 1575 | MBh | 42.9 | 43.5 | 44.7 | - | 42.5 | 43.1 | 44.4 | - | 41.4 | 42.0 | 43.3 | - | 39.6 | 40.2 | 41.4 | - | 37.3 | 37.9 | 39.1 | - | 35.2 | 35.8 | 37.0 | - |
| | S/T | 0.63 | 0.57 | 0.44 | - | 0.64 | 0.57 | 0.45 | - | 0.66 | 0.59 | 0.47 | - | 0.68 | 0.61 | 0.49 | - | 1.00 | 0.63 | 0.51 | - | 1.00 | 0.68 | 0.56 | - |
| | ΔT | 20.49 | 18.38 | 14.43 | - | 20.43 | 18.32 | 14.37 | - | 20.73 | 18.62 | 14.67 | - | 20.41 | 18.30 | 14.35 | - | 20.13 | 18.01 | 14.07 | - | 21.45 | 19.34 | 15.39 | - |
| | kW | 2.23 | 2.23 | 2.22 | - | 2.49 | 2.49 | 2.49 | - | 2.79 | 2.79 | 2.78 | - | 3.11 | 3.10 | 3.10 | - | 3.46 | 3.46 | 3.46 | - | 3.88 | 3.88 | 3.87 | - |
| | Amps | 7.9 | 7.9 | 7.9 | - | 9.0 | 9.0 | 9.0 | - | 10.3 | 10.3 | 10.3 | - | 11.7 | 11.7 | 11.7 | - | 13.2 | 13.2 | 13.2 | - | 15.1 | 15.1 | 15.0 | - |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 1040 | MBh | 41.2 | 41.8 | 43.1 | 45.0 | 40.9 | 41.4 | 42.7 | 44.6 | 39.8 | 40.4 | 41.6 | 43.5 | 37.9 | 38.5 | 39.7 | 41.6 | 35.6 | 36.2 | 37.4 | 39.3 | 33.5 | 34.1 | 35.4 | 37.3 |
| | S/T | 0.58 | 0.51 | 0.38 | 0.25 | 0.58 | 0.51 | 0.39 | 0.26 | 0.60 | 0.54 | 0.41 | 0.28 | 1.00 | 0.55 | 0.43 | 0.30 | 1.00 | 0.57 | 0.45 | 0.32 | 1.00 | 0.62 | 0.50 | 0.37 |
| | ΔT | 29.20 | 27.09 | 23.15 | 19.06 | 29.14 | 27.03 | 23.09 | 19.00 | 29.44 | 27.33 | 23.38 | 19.30 | 29.12 | 27.01 | 23.07 | 18.98 | 28.84 | 26.73 | 22.78 | 18.70 | 30.16 | 28.05 | 24.11 | 20.02 |
| | kW | 2.18 | 2.18 | 2.18 | 2.20 | 2.45 | 2.45 | 2.44 | 2.46 | 2.74 | 2.74 | 2.74 | 2.76 | 3.06 | 3.06 | 3.05 | 3.07 | 3.42 | 3.42 | 3.41 | 3.43 | 3.84 | 3.83 | 3.83 | 3.85 |
| | Amps | 7.7 | 7.7 | 7.7 | 7.7 | 8.8 | 8.8 | 8.8 | 8.9 | 10.1 | 10.1 | 10.1 | 10.2 | 11.5 | 11.5 | 11.5 | 11.6 | 13.1 | 13.0 | 13.0 | 13.1 | 14.9 | 14.9 | 14.8 | 14.9 |
| 1400 | MBh | 42.3 | 42.9 | 44.1 | 46.0 | 41.9 | 42.5 | 43.7 | 45.6 | 40.8 | 41.4 | 42.6 | 44.5 | 38.9 | 39.5 | 40.8 | 42.7 | 36.6 | 37.2 | 38.5 | 40.4 | 34.6 | 35.1 | 36.4 | 38.3 |
| | S/T | 0.72 | 0.65 | 0.53 | 0.40 | 0.73 | 0.66 | 0.53 | 0.40 | 0.75 | 0.68 | 0.56 | 0.43 | 1.00 | 0.70 | 0.57 | 0.45 | 1.00 | 0.72 | 0.59 | 0.47 | 1.00 | 0.76 | 0.64 | 0.51 |
| | ΔT | 26.21 | 24.09 | 20.15 | 16.07 | 26.15 | 24.04 | 20.09 | 16.01 | 26.45 | 24.33 | 20.39 | 16.30 | 26.13 | 24.02 | 20.07 | 15.99 | 25.85 | 23.73 | 19.79 | 15.70 | 27.17 | 25.06 | 21.11 | 17.03 |
| | kW | 2.22 | 2.21 | 2.21 | 2.23 | 2.48 | 2.48 | 2.47 | 2.49 | 2.77 | 2.77 | 2.77 | 2.79 | 3.09 | 3.09 | 3.09 | 3.11 | 3.45 | 3.45 | 3.44 | 3.46 | 3.87 | 3.87 | 3.86 | 3.88 |
| | Amps | 7.8 | 7.8 | 7.8 | 7.9 | 9.0 | 9.0 | 8.9 | 9.0 | 10.3 | 10.2 | 10.2 | 10.3 | 11.6 | 11.6 | 11.6 | 11.7 | 13.2 | 13.2 | 13.2 | 13.3 | 15.0 | 15.0 | 15.0 | 15.1 |
| 1040 | MBh | 42.9 | 43.5 | 44.8 | 46.7 | 42.6 | 43.1 | 44.4 | 46.3 | 41.5 | 42.1 | 43.3 | 45.2 | 39.6 | 40.2 | 41.4 | 43.3 | 37.3 | 37.9 | 39.1 | 41.0 | 35.2 | 35.8 | 37.0 | 38.9 |
| | S/T | 0.75 | 0.68 | 0.56 | 0.43 | 0.76 | 0.69 | 0.57 | 0.44 | 1.00 | 0.71 | 0.59 | 0.46 | 1.00 | 0.73 | 0.61 | 0.48 | 1.00 | 0.75 | 0.63 | 0.50 | 1.00 | 0.79 | 0.67 | 0.54 |
| | ΔT | 25.13 | 23.02 | 19.08 | 14.99 | 25.07 | 22.96 | 19.02 | 14.93 | 25.37 | 23.26 | 19.32 | 15.23 | 25.05 | 22.94 | 19.00 | 14.91 | 24.77 | 22.66 | 18.72 | 14.63 | 26.09 | 23.98 | 20.04 | 15.95 |
| | kW | 2.23 | 2.22 | 2.22 | 2.24 | 2.49 | 2.49 | 2.48 | 2.50 | 2.79 | 2.78 | 2.78 | 2.80 | 3.10 | 3.10 | 3.10 | 3.12 | 3.46 | 3.46 | 3.45 | 3.47 | 3.88 | 3.88 | 3.87 | 3.89 |
| | Amps | 7.87 | 7.87 | 7.85 | 7.93 | 9.02 | 9.01 | 8.99 | 9.08 | 10.30 | 10.30 | 10.28 | 10.36 | 11.69 | 11.68 | 11.66 | 11.75 | 13.24 | 13.23 | 13.21 | 13.30 | 15.06 | 15.05 | 15.03 | 15.12 |

Shaded area is ACCA (TVA) conditions

IDB = Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA – ALXT7CA6010**/CA*TA6030*3A*+EEP - LOW STAGE (CONT.)

| IDB | | OUTDOOR AMBIENT TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
|----------|------|--------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------|------|------|------|-------|------|------|------|
| | | 65°F | | | | 75°F | | | | 85°F | | | | 95°F | | | | 105°F | | | | 115°F | | | |
| | | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 | 59 | 63 | 67 | 71 |
| AIREFLOW | | ENTERING INDOOR WET BULB TEMPERATURE | | | | | | | | | | | | | | | | | | | | | | | |
| 80 | MBh | 41.4 | 42.0 | 43.3 | 45.2 | 41.1 | 41.7 | 42.9 | 44.8 | 40.0 | 40.6 | 41.8 | 43.7 | 38.1 | 38.7 | 39.9 | 41.8 | 35.8 | 36.4 | 37.7 | 39.6 | 33.7 | 34.3 | 35.6 | 37.5 |
| | S/T | 0.69 | 0.62 | 0.50 | 0.4 | 1.00 | 0.63 | 0.50 | 0.4 | 1.00 | 0.65 | 0.53 | 0.4 | 1.00 | 0.67 | 0.54 | 0.4 | 1.00 | 0.69 | 0.56 | 0.4 | 1.00 | 1.00 | 0.61 | 0.5 |
| | ΔT | 33.9 | 31.8 | 27.8 | 23.7 | 33.8 | 31.7 | 27.8 | 23.7 | 34.1 | 32.0 | 28.1 | 24.0 | 33.8 | 31.7 | 27.7 | 23.7 | 33.5 | 31.4 | 27.5 | 23.4 | 34.8 | 32.7 | 28.8 | 24.7 |
| | kW | 2.18 | 2.18 | 2.18 | 2.2 | 2.45 | 2.45 | 2.44 | 2.5 | 2.74 | 2.74 | 2.74 | 2.8 | 3.06 | 3.06 | 3.06 | 3.1 | 3.42 | 3.42 | 3.41 | 3.4 | 3.84 | 3.84 | 3.84 | 3.9 |
| | Amps | 7.7 | 7.7 | 7.7 | 7.7 | 8.8 | 8.8 | 8.8 | 8.9 | 10.1 | 10.1 | 10.1 | 10.2 | 11.5 | 11.5 | 11.5 | 11.6 | 13.1 | 13.0 | 13.0 | 13.1 | 14.9 | 14.9 | 14.8 | 14.9 |
| 1040 | MBh | 42.5 | 43.1 | 44.3 | 46.2 | 42.1 | 42.7 | 43.9 | 45.8 | 41.0 | 41.6 | 42.9 | 44.8 | 39.1 | 39.7 | 41.0 | 42.9 | 36.9 | 37.4 | 38.7 | 40.6 | 34.8 | 35.4 | 36.6 | 38.5 |
| | S/T | 0.83 | 0.77 | 0.64 | 0.5 | 1.00 | 0.77 | 0.65 | 0.5 | 1.00 | 0.79 | 0.67 | 0.5 | 1.00 | 0.81 | 0.69 | 0.6 | 1.00 | 0.83 | 0.71 | 0.6 | 1.00 | 1.00 | 0.75 | 0.6 |
| | ΔT | 30.9 | 28.8 | 24.8 | 20.7 | 30.8 | 28.7 | 24.8 | 20.7 | 31.1 | 29.0 | 25.1 | 21.0 | 30.8 | 28.7 | 24.7 | 20.7 | 30.5 | 28.4 | 24.5 | 20.4 | 31.8 | 29.7 | 25.8 | 21.7 |
| | kW | 2.22 | 2.21 | 2.21 | 2.23 | 2.48 | 2.48 | 2.47 | 2.49 | 2.78 | 2.77 | 2.77 | 2.79 | 3.09 | 3.09 | 3.09 | 3.11 | 3.45 | 3.45 | 3.44 | 3.46 | 3.87 | 3.87 | 3.86 | 3.88 |
| | Amps | 7.8 | 7.8 | 7.8 | 7.9 | 9.0 | 9.0 | 9.0 | 9.0 | 10.3 | 10.3 | 10.2 | 10.3 | 11.6 | 11.6 | 11.6 | 11.7 | 13.2 | 13.2 | 13.2 | 13.3 | 15.0 | 15.0 | 15.0 | 15.1 |
| 1575 | MBh | 43.1 | 43.7 | 45.0 | 46.9 | 42.8 | 43.4 | 44.6 | 46.5 | 41.7 | 42.3 | 43.5 | 45.4 | 39.8 | 40.4 | 41.6 | 43.5 | 37.5 | 38.1 | 39.4 | 41.3 | 35.4 | 36.0 | 37.3 | 39.2 |
| | S/T | 0.86 | 0.80 | 0.67 | 0.5 | 1.00 | 0.80 | 0.68 | 0.5 | 1.00 | 0.82 | 0.70 | 0.6 | 1.00 | 0.84 | 0.72 | 0.6 | 1.00 | 1.00 | 0.74 | 0.6 | 1.00 | 1.00 | 0.79 | 0.7 |
| | ΔT | 29.8 | 27.7 | 23.8 | 19.7 | 29.8 | 27.6 | 23.7 | 19.6 | 30.0 | 27.9 | 24.0 | 19.9 | 29.7 | 27.6 | 23.7 | 19.6 | 29.4 | 27.3 | 23.4 | 19.3 | 30.8 | 28.7 | 24.7 | 20.6 |
| | kW | 2.23 | 2.23 | 2.22 | 2.2 | 2.49 | 2.49 | 2.49 | 2.5 | 2.79 | 2.79 | 2.78 | 2.8 | 3.11 | 3.10 | 3.10 | 3.1 | 3.46 | 3.46 | 3.46 | 3.5 | 3.88 | 3.88 | 3.87 | 3.9 |
| | Amps | 7.9 | 7.9 | 7.9 | 7.9 | 9.0 | 9.0 | 9.0 | 9.1 | 10.3 | 10.3 | 10.3 | 10.4 | 11.7 | 11.7 | 11.7 | 11.8 | 13.2 | 13.2 | 13.2 | 13.3 | 15.1 | 15.1 | 15.0 | 15.1 |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 85 | MBh | 42.1 | 42.7 | 44.0 | 45.9 | 41.8 | 42.4 | 43.6 | 45.5 | 40.7 | 41.3 | 42.5 | 44.4 | 38.8 | 39.4 | 40.6 | 42.6 | 36.5 | 37.1 | 38.4 | 40.3 | 34.4 | 35.0 | 36.3 | 38.2 |
| | S/T | 1.00 | 0.71 | 0.59 | 0.5 | 1.00 | 0.72 | 0.60 | 0.5 | 1.00 | 0.74 | 0.62 | 0.5 | 1.00 | 1.00 | 0.64 | 0.5 | 1.00 | 1.00 | 0.66 | 0.5 | 1.00 | 1.00 | 0.70 | 0.6 |
| | ΔT | 38.0 | 35.9 | 32.0 | 27.9 | 38.0 | 35.9 | 31.9 | 27.8 | 38.3 | 36.2 | 32.2 | 28.1 | 37.9 | 35.8 | 31.9 | 27.8 | 37.7 | 35.5 | 31.6 | 27.5 | 39.0 | 36.9 | 32.9 | 28.8 |
| | kW | 2.19 | 2.19 | 2.18 | 2.2 | 2.45 | 2.45 | 2.45 | 2.5 | 2.75 | 2.75 | 2.74 | 2.8 | 3.07 | 3.07 | 3.06 | 3.1 | 3.42 | 3.42 | 3.42 | 3.4 | 3.84 | 3.84 | 3.84 | 3.9 |
| | Amps | 7.7 | 7.7 | 7.7 | 7.8 | 8.9 | 8.9 | 8.8 | 8.9 | 10.1 | 10.1 | 10.1 | 10.2 | 11.5 | 11.5 | 11.5 | 11.6 | 13.1 | 13.1 | 13.1 | 13.1 | 14.9 | 14.9 | 14.9 | 15.0 |
| 1400 | MBh | 43.2 | 43.8 | 45.0 | 46.9 | 42.8 | 43.4 | 44.6 | 46.5 | 41.7 | 42.3 | 43.6 | 45.5 | 39.9 | 40.4 | 41.7 | 43.6 | 37.6 | 38.2 | 39.4 | 41.3 | 35.5 | 36.1 | 37.3 | 39.2 |
| | S/T | 1.00 | 0.86 | 0.73 | 0.6 | 1.00 | 0.86 | 0.74 | 0.6 | 1.00 | 1.00 | 0.76 | 0.6 | 1.00 | 1.00 | 0.78 | 0.7 | 1.00 | 1.00 | 0.80 | 0.7 | 1.00 | 1.00 | 0.85 | 0.7 |
| | ΔT | 35.0 | 32.9 | 29.0 | 24.9 | 35.0 | 32.9 | 28.9 | 24.8 | 35.3 | 33.2 | 29.2 | 25.1 | 34.9 | 32.8 | 28.9 | 24.8 | 34.7 | 32.6 | 28.6 | 24.5 | 36.0 | 33.9 | 29.9 | 25.8 |
| | kW | 2.22 | 2.22 | 2.22 | 2.24 | 2.49 | 2.48 | 2.48 | 2.50 | 2.78 | 2.78 | 2.77 | 2.79 | 3.10 | 3.10 | 3.09 | 3.11 | 3.46 | 3.45 | 3.45 | 3.47 | 3.87 | 3.87 | 3.87 | 3.89 |
| | Amps | 7.9 | 7.8 | 7.8 | 7.9 | 9.0 | 9.0 | 9.0 | 9.1 | 10.3 | 10.3 | 10.3 | 10.3 | 11.7 | 11.7 | 11.6 | 11.7 | 13.2 | 13.2 | 13.2 | 13.3 | 15.0 | 15.0 | 15.0 | 15.1 |
| 1575 | MBh | 43.8 | 44.4 | 45.7 | 47.6 | 43.5 | 44.1 | 45.3 | 47.2 | 42.4 | 43.0 | 44.2 | 46.1 | 40.5 | 41.1 | 42.3 | 44.2 | 38.2 | 38.8 | 40.1 | 42.0 | 36.1 | 36.7 | 38.0 | 39.9 |
| | S/T | 1.00 | 0.89 | 0.76 | 0.6 | 1.00 | 0.89 | 0.77 | 0.6 | 1.00 | 1.00 | 0.79 | 0.7 | 1.00 | 1.00 | 0.81 | 0.7 | 1.00 | 1.00 | 0.83 | 0.7 | 1.00 | 1.00 | 0.88 | 0.7 |
| | ΔT | 34.0 | 31.8 | 27.9 | 23.8 | 33.9 | 31.8 | 27.8 | 23.8 | 34.2 | 32.1 | 28.1 | 24.1 | 33.9 | 31.8 | 27.8 | 23.7 | 33.6 | 31.5 | 27.5 | 23.5 | 34.9 | 32.8 | 28.9 | 24.8 |
| | kW | 2.23 | 2.23 | 2.23 | 2.2 | 2.50 | 2.50 | 2.49 | 2.5 | 2.79 | 2.79 | 2.79 | 2.8 | 3.11 | 3.11 | 3.10 | 3.1 | 3.47 | 3.47 | 3.46 | 3.5 | 3.89 | 3.88 | 3.88 | 3.9 |
| | Amps | 7.9 | 7.9 | 7.9 | 8.0 | 9.1 | 9.0 | 9.0 | 9.1 | 10.3 | 10.3 | 10.3 | 10.4 | 11.7 | 11.7 | 11.7 | 11.8 | 13.3 | 13.3 | 13.2 | 13.3 | 15.1 | 15.1 | 15.1 | 15.1 |

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area is ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)


PERFORMANCE DATA - LOW STAGE

| ALXT7CA2410**/CA*TA2422*3A* | | | | |
|---|---------------|---------------|--------------|--------------|
| CONDITIONS: 80 °F IBD, 67 °F IWB @ 840 CFM | | | | |
| OUTDOOR TEM. ° F. | TOTAL BTUH | SENSIBLE BTUH | LATENT BTUH | TOTAL WATTS |
| 75 | 25,730 | 17,930 | 7,800 | 1,610 |
| 80 | 25,415 | 18,015 | 7,400 | 1,700 |
| 85 | 25,100 | 18,100 | 7,000 | 1,790 |
| 90 | 24,550 | 17,935 | 6,615 | 1,885 |
| 95 | 24,000 | 17,770 | 6,230 | 1,980 |
| 100 | 23,330 | 17,515 | 5,815 | 2,090 |
| 105 | 22,660 | 17,260 | 5,400 | 2,200 |
| 110 | 22,050 | 17,330 | 4,720 | 2,325 |
| 115 | 21,440 | 17,400 | 4,040 | 2,450 |
| TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB | | | | |
| 95° | 23,140 | 17,360 | 5,780 | 1,980 |

| ALXT7CA3610**/CA*TA3626*3A* | | | | |
|---|---------------|---------------|--------------|--------------|
| CONDITIONS: 80 °F IBD, 67 °F IWB @ 1120 CFM | | | | |
| OUTDOOR TEM. ° F. | TOTAL BTUH | SENSIBLE BTUH | LATENT BTUH | TOTAL WATTS |
| 75 | 37,530 | 25,800 | 11,730 | 2,330 |
| 80 | 37,065 | 25,920 | 11,145 | 2,465 |
| 85 | 36,600 | 26,040 | 10,560 | 2,600 |
| 90 | 35,800 | 25,800 | 10,000 | 2,745 |
| 95 | 35,000 | 25,560 | 9,440 | 2,890 |
| 100 | 34,020 | 25,195 | 8,825 | 3,055 |
| 105 | 33,040 | 24,830 | 8,210 | 3,220 |
| 110 | 32,150 | 24,935 | 7,215 | 3,410 |
| 115 | 31,260 | 25,040 | 6,220 | 3,600 |
| TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB | | | | |
| 95° | 33,750 | 24,980 | 8,770 | 2,890 |

| ALXT7CA4810**/CA*TA6030*3A* | | | | |
|---|---------------|---------------|---------------|--------------|
| CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM | | | | |
| OUTDOOR TEM. ° F. | TOTAL BTUH | SENSIBLE BTUH | LATENT BTUH | TOTAL WATTS |
| 75 | 50,400 | 32,750 | 17,650 | 3,200 |
| 80 | 49,775 | 32,900 | 16,875 | 3,380 |
| 85 | 49,150 | 33,050 | 16,100 | 3,560 |
| 90 | 48,075 | 32,745 | 15,330 | 3,755 |
| 95 | 47,000 | 32,440 | 14,560 | 3,950 |
| 100 | 45,685 | 31,980 | 13,705 | 4,165 |
| 105 | 44,370 | 31,520 | 12,850 | 4,380 |
| 110 | 43,175 | 31,650 | 11,525 | 4,635 |
| 115 | 41,980 | 31,780 | 10,200 | 4,890 |
| TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB | | | | |
| 95° | 45,320 | 31,700 | 13,620 | 3,950 |

| ALXT7CA6010**/CA*TA6030*3A* | | | | |
|---|---------------|---------------|---------------|--------------|
| CONDITIONS: 80 °F IBD, 67 °F IWB @ 1485 CFM | | | | |
| OUTDOOR TEM. ° F. | TOTAL BTUH | SENSIBLE BTUH | LATENT BTUH | TOTAL WATTS |
| 75 | 61,120 | 38,560 | 22,560 | 3,930 |
| 80 | 60,360 | 38,745 | 21,615 | 4,165 |
| 85 | 59,600 | 38,930 | 20,670 | 4,400 |
| 90 | 58,300 | 38,565 | 19,735 | 4,655 |
| 95 | 57,000 | 38,200 | 18,800 | 4,910 |
| 100 | 55,410 | 37,660 | 17,750 | 5,195 |
| 105 | 53,820 | 37,120 | 16,700 | 5,480 |
| 110 | 52,365 | 37,275 | 15,090 | 5,810 |
| 115 | 50,910 | 37,430 | 13,480 | 6,140 |
| TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB | | | | |
| 95° | 54,970 | 37,330 | 17,640 | 4,910 |

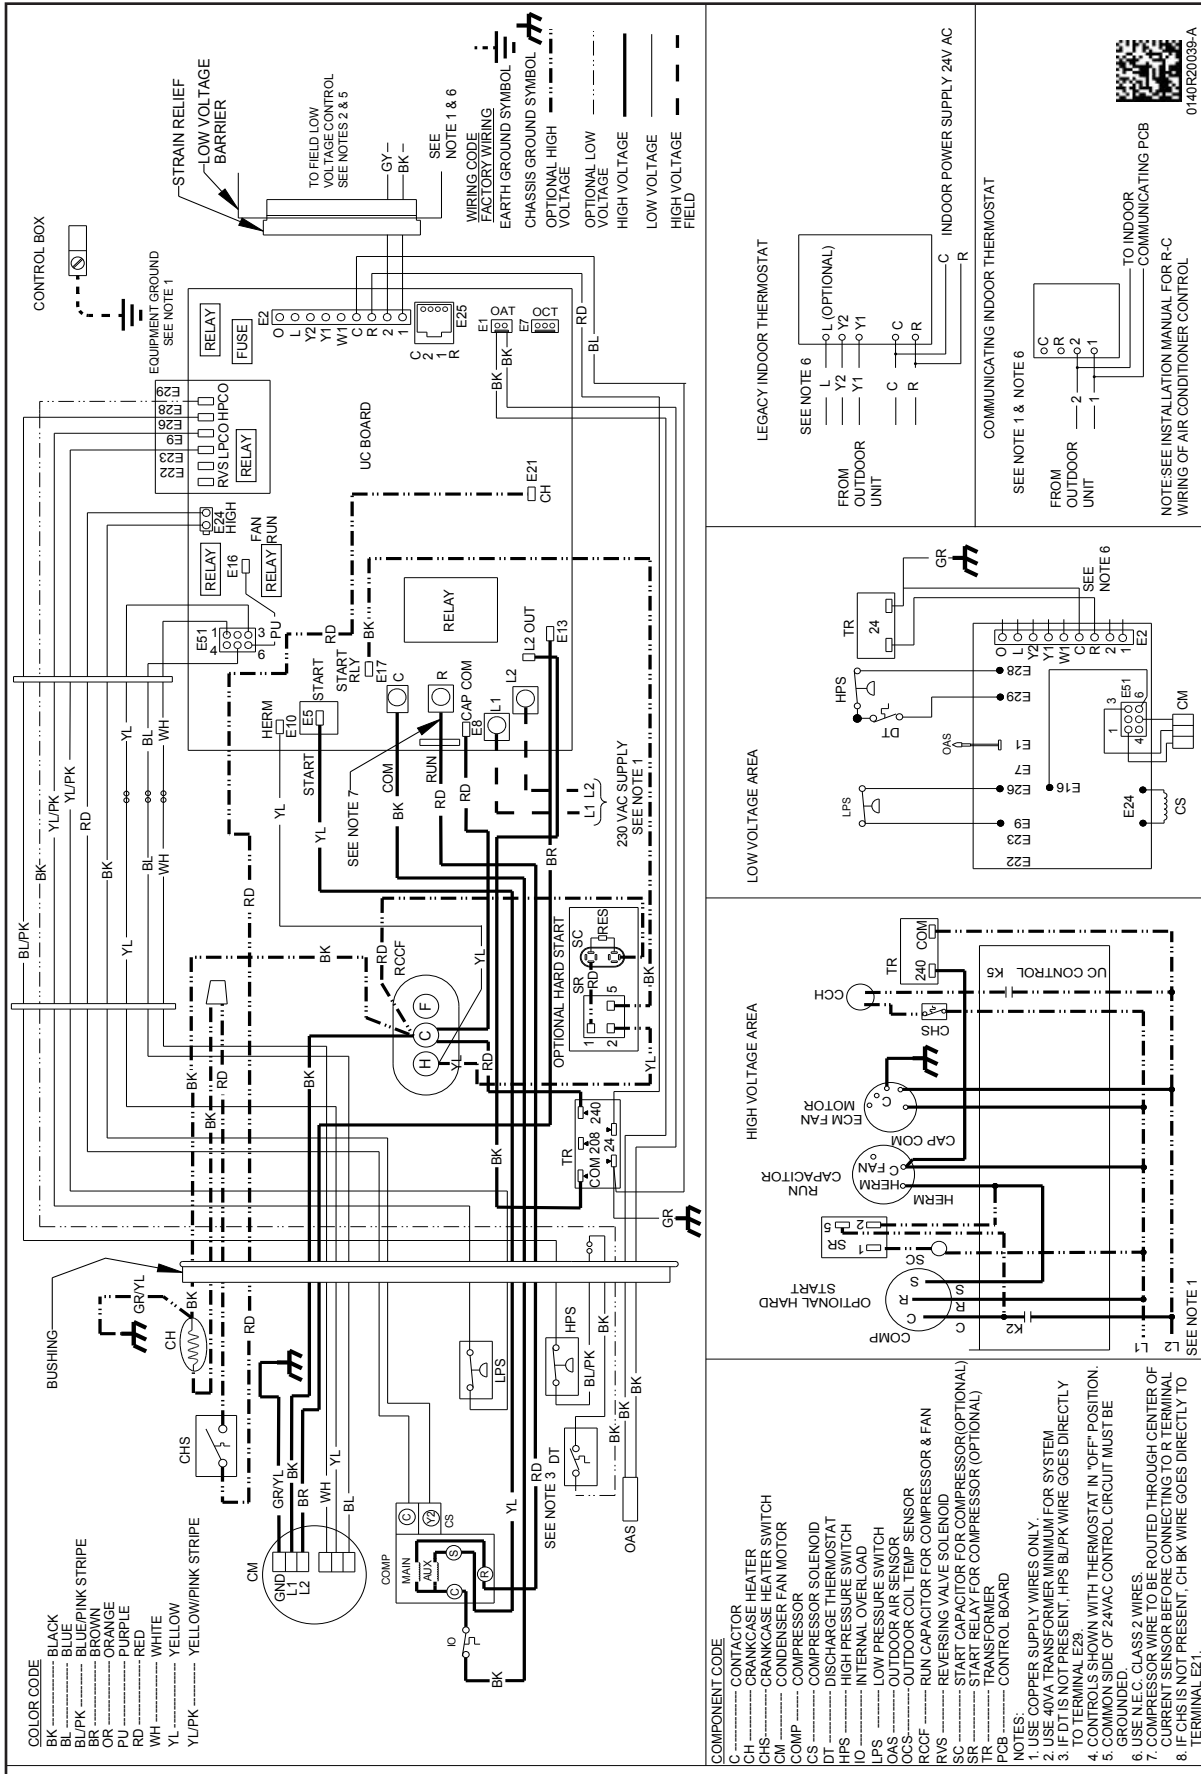


WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

DIMENSIONS

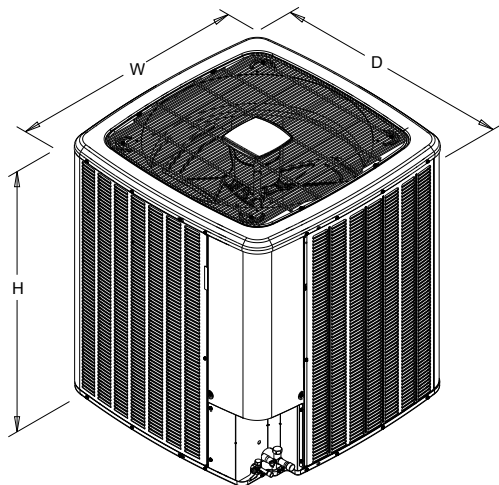

| MODEL | DIMENSIONS | | |
|--------------|------------|-----|-----|
| | W" | D" | H" |
| ALXT7C2410A* | 35½ | 35½ | 39½ |
| ALXT7C3610A* | 35½ | 35½ | 39½ |
| ALXT7C4810A* | 35½ | 35½ | 41⅝ |
| ALXT7C6010A* | 35½ | 35½ | 41⅝ |

ACCESSORIES

| MODEL | DESCRIPTION | ALXT7CA 2410A* | ALXT7CA 3610A* | ALXT7CA 4810A* | ALXT7CA 6010A* |
|-------------------------------------|---------------------------------------|-------------------|-------------------|-------------------|-------------------|
| ABK-20 | Anchor Bracket Kit [^] | X | X | X | X |
| ASC-01 | Anti-Short Cycle Kit | X | X | X | X |
| CSR-U-1 | Hard-start Kit | X | X | | |
| CSR-U-2 | Hard-start Kit | | | X | |
| CSR-U-3 | Hard-start Kit | | | | X |
| Factory Installed Crank Case Heater | | | | X | X |
| FSK01A ¹ | Freeze Protection Kit | X | X | X | X |
| LSK02A ² | Liquid Line Solenoid Kit | X | X | X | X |
| OT18-60A | Outdoor Thermostat/Lockout Thermostat | X | X | X | X |
| TXV-FX-KX-2T | TXV Kit | X | | | |
| TXV-FX-KX-3T | TXV Kit | | X | | |
| TXV-FX-KX-5T | TXV Kit | | | X | X |

[^] Contains 20 brackets; four brackets needed to anchor unit to pad

¹ Installed on indoor coil

² Condensing units and heat pumps with reciprocating or rotary compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.

All AHRI system ratings are accessible in the System Configurator tool via PartnerLink.

